

flexotron®800 Ventilation

**Liste der Netzwerkvariablen für
die Modbus-Kommunikation**

Benutzerhandbuch

P100012093

HAFTUNGSAUSSCHLUSS

Die in diesem Handbuch enthaltenen Informationen wurden sorgfältig geprüft und werden als korrekt erachtet. Dennoch übernimmt SAUTER keine Gewährleistung hinsichtlich des Inhalts dieses Handbuchs, und Benutzer werden darum gebeten, Fehler, Unstimmigkeiten oder Unklarheiten an SAUTER zu melden, damit zukünftige Fassungen entsprechend angepasst werden können. Die in diesem Handbuch enthaltenen Informationen können ohne Vorankündigung geändert werden.

Die in diesem Dokument beschriebene Software wird im Rahmen einer Lizenz von SAUTER geliefert und darf nur unter Einhaltung der Lizenzbedingungen verwendet und kopiert werden. Ohne die ausdrückliche, schriftliche Genehmigung von SAUTER darf keinerlei Teil vorliegenden Handbuchs in irgendeiner Form oder auf irgendeine Weise, sei es elektronisch oder mechanisch, vervielfältigt oder übertragen werden.

HANDELSMARKEN

Windows, Windows 2000, Windows XP und Windows Server 2003 sind eingetragene Warenzeichen der Microsoft Corporation.

Die in vorliegendem Handbuch aufgeführten Produktnamen dienen lediglich dem Zweck der Identifizierung und können eingetragene Marken der jeweiligen Inhaber sein.

Softwareversion 3.1

Februar 2013

Inhaltsverzeichnis

Inhaltsverzeichnis.....	3
Änderungsverzeichnis	4
1 Vorwort	5
2 flexotron® 800 mit Modbus-Kommunikation.....	6
3 Systemintegration über Modbus	9
4 Coil Status Register	11
5 Input Register	12
6 Holding Register	35
7 Input Status Register	60

Änderungsverzeichnis

Änderungsverzeichnis

Datum	Ausgabe Rev./Ver.	Änderung	Kapitel	Seite
12.02.2013	P100012093	Neuerstellung	Alle	Alle

1 Vorwort

Das Benutzerhandbuch wird von SAUTER ohne Garantie bereitgestellt. SAUTER kann zu jeder Zeit und ohne vorherige Ankündigung, Änderungen und Verbesserungen im Handbuch vornehmen. Alle Änderungen werden in die zukünftigen Versionen dieses Handbuches einfließen.

Revisionstand A, Februar 2013

2 flexotron@800 mit Modbus-Kommunikation

Einführung

Bei flexotron@800 Ventilation handelt es sich um eine vorprogrammierte Anwendung zur Steuerung von Klimageräten. Der flexotron@800 Regler kann entweder separat verwendet oder in ein vorhandenes Projekt integriert werden. In beiden Fällen wird die Konfiguration über das Display oder das Konfigurationstool SAUTER CASE flexotron@ auf einem PC vorgenommen.

In vorliegendem Dokument werden alle Signale beschrieben, auf die über Modbus zugegriffen werden kann. This document does not describe how to create a project.

Signaltypen

Alle Signale, auf die von einem SCADA-System aus zugegriffen werden kann, werden in vorliegendem Handbuch beschrieben.

Signale, die einen Standardwert aufweisen, sind konfigurierbar. Diese Einstellungen können über SCADA geändert werden. Signale ohne Standardwerte sind Ist-Werte, die nicht über SCADA geändert werden können.

Variablentypen

Folgende Typen von Variablen sind vorhanden:

- R = Real (-3.3E38 - 3.3E38)
- I = Integer (-32768 - 32767)
- X = Index (0 - 255)
- L = Logic (0/1)

Modbus-Typen

Für die Signale gibt es folgende Modbus-Typen:

- 1 = Coil Status Register (Spulenstatusregister) (Modbus-Funktion = 1, 5 und 15)
- 2 = Input Status Register (Eingangstatusregister) (Modbus-Funktion = 2)
- 3 = Holding Register (Modbus-Funktion = 3, 6 und 16)
- 4 = Input Register (Eingangsregister) (Modbus-Funktion = 4)

Unterstützte Modbus-Funktionen:

- 1 = Read Coils
- 2 = Read Discrete Input
- 3 = Read Holding Register
- 4 = Read Input Register
- 5 = Write Single Coil
- 6 = Write Single Register
- 15 = Write Multiple Coils
- 16 = Write Multiple Registers

Max. 47 Register

In einer Meldung können maximal 47 Register gelesen werden.

Kommunikation – Grenzwerte

Zwischen zwei Meldungen muss der Modbus-Master mindestens 3,5 Zeichen warten (4 ms bei 9.600 bps). Wenn der Modbus-Master mit mehr als einem flexotron@800 Regler über ein und dieselbe Kommunikationsleitung (RS485) kommuniziert, ist ein Ruheintervall von mindestens 14 Zeichen (16 ms bei 9.600 bps) zwischen der Antwort und der ersten Anfrage an den nächsten Regler erforderlich.

Bei dem flexotron@800 Regler ist die Anzahl der schnellen Kommunikationsverbindungen je halbe Minute auf 10 begrenzt. Alle anderen Kommunikationsverbindungen antworten mit einer Verzögerung von ungefähr 1 Sekunde.

Modbus – Skalierungsfaktor

Real-Signale besitzen einen Skalierungsfaktor von 10; Ausnahmen sind die Zeiteinstellungssignale, die einen Skalierungsfaktor von 100 besitzen, und Luftstromsignale, die für die Modbus-Kommunikation einen Skalierungsfaktor von 1 besitzen. „Integer“, „Index“ und „Logic“ besitzen immer einen Skalierungsfaktor von 1.

Modbus-Aktivierung

Wenn Sie versuchen, mithilfe von Case flexotron® mit einem über Modbus aktivierten Gerät zu kommunizieren, erfolgt die Anpassung des Eingangsports automatisch nach ungefähr 1 Sekunde. Der Port bleibt solange im EXO-Modus (ein proprietäres Protokoll), bis die Kommunikation 10 Sekunden lang inaktiv war. Nach diesen 10 Sekunden kehrt der Port in den Modbus-Modus zurück.

Modbus-Verdrahtung usw.

Protokolle wie Modbus bestehen aus mehreren Schichten (OSI-Modell). Bei der untersten Schicht handelt es sich stets um die physikalische Schicht, die Anzahl der Drähte und die Signalpegel. Die nächste Schicht beschreibt die kommunikationsbezogenen Stellen (Anzahl von Datenbits, Stoppbits, Parität usw.). Die folgenden Schichten beschreiben die Modbus-spezifischen Funktionen (Anzahl von Stellen pro Meldung, Bedeutung der unterschiedlichen Meldungen usw.). Bei Modbus kann die unterste Schicht entweder RS485, RS422 oder RS232 sein.


RS485 versus RS422

Bei RS485 und RS422 handelt es sich um den elektrischen Teil des Protokolls, d. h. die physikalische Schicht.

RS485 besitzt zwei Anschlüsse: A und B. Häufig ist zudem Schutzerde vorhanden. RS485-Geräte werden stets wie folgt angeschlossen: A → A und B → B. RS485 ist für die sogenannte Halbduplex-Kommunikation zuständig. Die Kommunikation kann jeweils nur in eine Richtung verlaufen, d. h. der Master sendet eine Anfrage und wartet auf die Antwort. A und B werden sowohl für die Übertragung als auch für den Empfang verwendet.

RS422 ist eine Vollduplex-Kommunikation, d. h. Sie benötigen vier Drähte: zwei für die Übertragung (Tx+ und Tx-) und zwei für den Empfang (Rx+ und Rx-). Tx dient der Übertragung, Rx dem Empfang. Daraus folgt, dass Tx in dem einen Gerät mit Rx in dem anderen Gerät verbunden sein muss (und umgekehrt). Hinsichtlich der Signalpegel sind RS422 und RS485 identisch.

Führen Sie die folgenden Schritte aus, um RS485 und RS422 miteinander zu verbinden: Verbinden Sie am RS422-Gerät Tx+ mit Rx+ und Tx- mit Rx-. Auf diese Weise wird ein Vierdraht-System zu einem Zweidraht-System umgewandelt, das dann über A und B an das RS485-Gerät angeschlossen werden kann. Welcher Draht an welcher Stelle angeschlossen werden muss, können Sie durch Ausprobieren feststellen. Bei vertauschter Polung funktioniert das Gerät nicht; das Gerät wird dadurch jedoch nicht beschädigt.

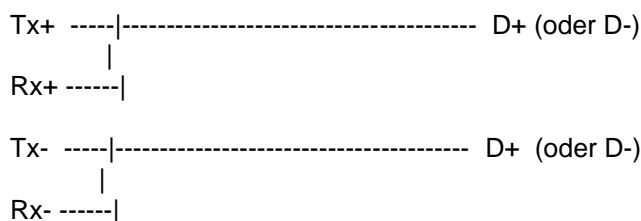


Die nächste Schicht besteht aus Bitrate, einem Stoppbit, Parität.

Diese Einstellungen müssen den Einstellungen im Master-Gerät entsprechen. Bringen Sie in Erfahrung, wie das Master-Gerät eingestellt ist, und richten Sie flexotron®800 auf der Grundlage dieser Einstellungen ein.

Die Parität kann auf ungerade, gerade bzw. keine Parität gesetzt werden. Sie können nur ein Stopbit wählen. 1 Startbit, 8 Datenbits, 1 Paritätsbit und 1 Stopbit ergeben 11 Bits (Maximum).

Beispiel zur Veranschaulichung

Anhand des vereinfachten Beispiels unten soll die Master/Slave-Beziehung verdeutlicht werden. Zusätzlich zu dem Wert werden die Prüfsummen für die Meldungsvalidierung sowohl in der Anfrage als auch in der Antwort übertragen.

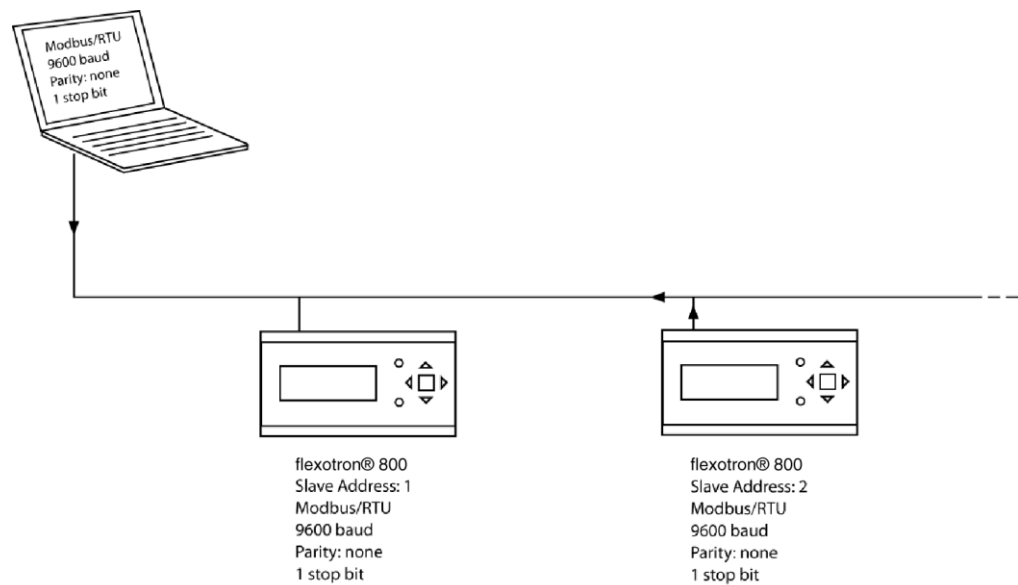


3 Systemintegration über Modbus

Konfiguration

Zunächst müssen die Kommunikationsparameter für die Modbus-Leitung konfiguriert werden. Wie bereits beschrieben, müssen diese Parameter identisch mit denen des Master-Geräts und der Slave-Geräte sein, da sie die Struktur der Meldungen sowie die Übertragungsgeschwindigkeit definieren.

Die standardmässigen Konfigurationswerte eines flexotron@800 Reglers werden in der untenstehenden Abbildung angezeigt.

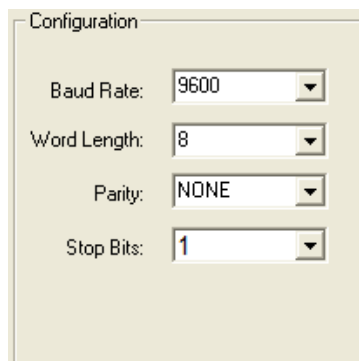

Configuration

Baud Rate: 9600

Word Length: 8

Parity: NONE

Stop Bits: 1

Übertragungsmodus

flexotron@800 verwendet den Übertragungsmodus RTU, der nicht mit dem ASCII-Modus in den Einstellungen zu verwechseln ist. Die Einstellungen für den Übertragungsmodus müssen denen des Master-Geräts und der Slave-Geräte entsprechen, da Modbus/RTU keine Modbus/ASCII-Meldungen versteht. Die Wortlänge der Konfigurationsparameter beträgt für Modbus/RTU immer 8.



Transmission Mode

STANDARD

ASCII RTU

Werte schreiben

Um die Ausgangswerte von flexotron@800 zu übersteuern, setzen Sie den Ausgang über ein Modbus-Signal auf manuellen Modus. Setzen Sie anschliessend das entsprechende „_ManSet“-Signal auf den gewünschten Pegel. Diese Signale werden in Kapitel 5 aufgeführt: Holding Register. Beachten Sie, dass nur Werte mit einem Standardwert angepasst werden können. Informationen zu diesen finden Sie in den Kapiteln „Coils Status Register“ und „Holding Register“.

Werte lesen

Sie können Werte auf effektive Weise lesen, indem Sie mehrere Variablen gleichzeitig lesen. Um beispielsweise sämtliche Analogausgänge zu lesen, setzen Sie die Modbus-Abfrage auf die in der folgenden Abbildung angezeigten Werte. Die erste Variable für den Analogausgang beginnt mit Adresse 54 (QAnaOut.AQ1). Zum Lesen von Adresse 54 bis 58 setzen Sie die Länge auf 5. Die Modbus-Antwort übermittelt nun alle fünf Werte in nur einer einzigen Meldung. Dadurch wird die Effektivität der Kommunikation erhöht.

Systemintegration über Modbus

Modbus Data	
Slave Address:	<input type="text" value="1"/>
Point Type:	<input type="text" value="04 INPUT REGISTER"/>
Point Address:	<input type="text" value="54"/>
Length:	<input type="text" value="5"/>

Coil Status Register

4 Coil Status Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
VentSettings.Cor_OverHeatFastStop	L	1	0	Settings, General	Enable fast stop if overheat alarm
VentSettings.Cor_CoolStepAlarmBlock	L	2	0	Settings, General	Block cooling step signals if this is set and alarm "Run Error P1-Cooler"
VentSettings.Cor_AlaAcknowAll	L	3	0	Settings, General	Command to acknowledge all alarms
VentSettings.Cor_AlaAcknowAll	L	3	0	Alarm Acknowledging, Blocking and Unblocking	Command to acknowledge all alarms
VentSettings.Cor_ReservedL	L	4	0	Settings, General	Not used
VentSettings.Cor_RecycleNightCool	L	5	0	Recirculation	Enable the night cool function when Recirculation run
VentSettings.Cor_RecycleExtraTime Group5	L	6	0	Recirculation	Use ExtraTimeGroup 5 to start Recirculation run
VentSettings. Cor_CompSAFOnly	L	7	0	SAF/EAF Pressure and Flow	Is set if only SAF pressure should be compensated
VentSettings.Cor_NeedControl	L	8	0	Settings, General	Enable support control if the unit is shut down
VentSettings.Cor_DeIcingFunction	L	9	0	Extract air temp/De-icing exchanger	Enable the de-icing function
VentSettings.Cor_FilterAlarmReset	L	10	0	Settings, General	Resets the filter alarm counter
VentSettings.Cor_ReservedL	L	11	0	Settings, General	Not used
VentSettings.Cor_ReservedL	L	12	0	Settings, General	Not used
VentSettings.Cor_ReservedL	L	13	0	Settings, General	Not used
VentSettings.Cor_ReservedL	L	14	0	Settings, General	Not used
VentSettings.Cor_ReservedL	L	15	0	Settings, General	Not used
VentSettings.Cor_ReservedL	L	16	0	Settings, General	Not used

Input Register

5 Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard- wert	Funktion	Beschreibung
VentActual.Cor_OutDoorTemp(0)	R	1		Actual/Setpoint	Outdoor temperature (read-only)
VentActual.Cor_Efficiency	R	2		Actual/Setpoint	Efficiency in % for exchanger
VentActual.Cor_RunMode	X	3		Actual/Setpoint	0=Stopped 1=Starting up 2=Starting reduced speed 3=Starting full speed 4=Starting normal run 5=Normal run 6=Support control heating 7=Support control cooling 8=CO ₂ run 9=Night cooling 10=Full speed stop 11=Stopping fan
VentActual.Cor_SAFRunTime	R	4		Actual/Setpoint	Running time (hour) supply air fan
VentActual.Cor_EAFRunTime	R	5		Actual/Setpoint	Running time (hour) extract air fan
VentActual.Cor_ExtendedRunMin	I	6		Actual/Setpoint	Number of minutes extended operation
VentActual.Cor_SupplyAirTemp	R	7		Supply, Extract and Room temperatures	Supply air temperature
VentActual.Cor_SupplyPID_SetP	R	8		Supply, Extract and Room temperatures	Calculated setpoint supply air temperature when outdoor compensated control function
VentActual.Cor_ExtractAirTemp	R	9		Supply, Extract and Room temperatures	Extract air temp
VentActual.Cor_RoomTemp1	R	10		Supply, Extract and Room temperatures	Room temperature 1
VentActual.Cor_RoomTemp2	R	11		Supply, Extract and Room temperatures	Room temperature 2
VentActual. Cor_NeedRunTime	I	12		Supply, Extract and Room temperatures	Number of minutes in ongoing support heating/cooling
VentActual.Cor_SAFPressure	R	13		SAF/EAF Pressure and Flow	Supply air fan pressure (Pa)
VentActual.Cor_EAFPressure	R	14		SAF/EAF Pressure and Flow	Extract air fan pressure (Pa)

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
VentActual.Cor_SAFAirFlow	R	15		SAF/EAF Pressure and Flow	Supply air fan flow (m3/h). Scale factor = 1
VentActual.Cor_EAFAirFlow	R	16		SAF/EAF Pressure and Flow	Extract air fan flow (m3/h) Scale factor = 1
VentActual.Cor_CO2Sensor	R	17		CO ₂	CO ₂ (ppm)
VentActual.Cor_DemandRunTime	I	18		CO ₂	Number of minutes support run time CO ₂
VentActual.Cor_FrostprotectionTemp	R	19		Frost protection	Frost protection temp
VentActual.Cor_ExhaustAirTemp	R	20		Extract air temp/De-icing exchanger	Exhaust air temp
VentActual.Cor_DelcingTemp	R	21		Extract air temp/De-icing exchanger	De-icing temp exchanger
VentActual.Cor_DelcingTime	X	22		Extract air temp/De-icing exchanger	Number of minutes for ongoing de-icing
VentActual.Cor_HumidityRoom	R	23		Humidity	Humidity room
VentActual.Cor_HumidityDuct	R	24		Humidity	Humidity duct
VentActual.Cor_ExtraSensor	R	25		Additional sensor/External setpoint	Extra sensor 1 / External setpoint (depending on the configuration)
VentActual.Cor_AnalogInput1(0)	R	26		Analogue inputs	The scaled and filtered value of AI1
VentActual.Cor_AnalogInput2	R	27		Analogue inputs	The scaled and filtered value of AI2
VentActual.Cor_AnalogInput3	R	28		Analogue inputs	The scaled and filtered value of AI3
VentActual.Cor_AnalogInput4	R	29		Analogue inputs	The scaled and filtered value of AI4
VentActual.Cor_AnalogInput5	R	30		Universal inputs	The scaled and filtered value of UAI1
VentActual.Cor_AnalogInput6	R	31		Universal inputs	The scaled and filtered value of UAI2
VentActual.Cor_AnalogInput7	R	32		Universal inputs	The scaled and filtered value of UAI3
VentActual.Cor_AnalogInput8	R	33		Universal inputs	The scaled and filtered value of UAI4
VentSettings.Cor_Ai1(0)	X	34		Analogue inputs	Connected signal on AI1: 0=Not used 1=Outdoor temp 2=Supply temp 3=Extract temp 4=Room temp1 5=Room temp2 6=Exhaust temp 7=Extrasensor

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
					8=SAF pressure 9=EAF pressure 10=Deicingtemp 11=Frost prot.temp 12=CO ₂ 13=Humidity room 14=Humidity duct 15=Extra unit temp 16=External SAF control 17=External EAF control 18=SAF pressure 2 19=Humidity outdoor
VentSettings.Cor_Ai2	X	35		Analogue inputs	Connected signal on AI2:
VentSettings.Cor_Ai3	X	36		Analogue inputs	Connected signal on AI3:
VentSettings.Cor_Ai4	X	37		Analogue inputs	Connected signal on AI4:
VentSettings.Cor_UAi1	X	38		Universal inputs	Connected signal on UAI1: 0=Not used 1=Outdoortemp 2=Supplytemp 3=Extracttemp 4=Roomtemp1 5=Roomtemp2 6=Exhausttemp 7=Extrasensor 8=SAF pressure 9=EAF pressure 10=Deicingtemp 11=Frost prot.temp 12=CO ₂ 13=Humidity room 14=Humidity duct 15=Extra unit temp 16=External SAF control 17=External EAF control 18=SAF pressure 2 19=Humidity outdoor
VentSettings.Cor_UAi2	X	39		Universal inputs	Connected signal on UAI2: (See signal list for UAI1)
VentSettings.Cor_UAi3	X	40		Universal inputs	Connected signal on UAI3: (See signal list for UAI1)
VentSettings.Cor_UAi4	X	41		Universal inputs	Connected signal on UAI4: (See signal list for UAI1)

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
VentSettings.Cor_Di1(0)	X	42		Digital inputs	Connected signal on DI1: 0=Not used 1=SAF-Ind 2=EAF-Ind 3=P1-Heating 4=P1-Exchanger 5=P1-Cooling 6=Filter guard 7=Fire alarm 8=Fire damper-ind 9=Ext run 1/1 10=Ext run ½ 11=External alarm 12=External switch 13=Flow guard 14=Rot.sent.exch 15=De-icing 16=Frostprotection 17=Overheatprotection 18=Recirculation run 19=Change over 20=Filter guard 2
VentSettings.Cor_Di2	X	43		Digital inputs	Connected signal on DI2: (See signal list for DI1)
VentSettings.Cor_Di3	X	44		Digital inputs	Connected signal on DI3: (See signal list for DI1)
VentSettings.Cor_Di4	X	45		Digital inputs	Connected signal on DI4: (See signal list for DI1)
VentSettings.Cor_Di5	X	46		Digital inputs	Connected signal on DI5: (See signal list for DI1)
VentSettings.Cor_Di6	X	47		Digital inputs	Connected signal on DI6: (See signal list for DI1)
VentSettings.Cor_Di7	X	48		Digital inputs	Connected signal on DI7: (See signal list for DI1)
VentSettings.Cor_Di8	X	49		Digital inputs	Connected signal on DI8: (See signal list for DI1)
VentSettings.Cor_UDi1	X	50		Universal inputs	Connected signal on UDI1: 0=Not used 1=SAF-Ind 2=EAF-Ind 3=P1-Heating 4=P1-Exchanger 5=P1-Cooling 6=Filter guard 7=Fire alarm 8=Fire damper-ind 9=Ext run 1/1 10=Ext run ½ 11=External alarm 12=External switch 13=Flow guard 14=Rot.sent.exch

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
					15=De-icing 16=Frostprotection 17=Overheatprotection 18=Recirculation run 19=Change over 20=Filter guard 2
VentSettings.Cor_UDi2	X	51		Universal inputs	Connected signal on UDI2: (See signal list for UDI1)
VentSettings.Cor_UDi3	X	52		Universal inputs	Connected signal on UDI3: (See signal list for UDI1)
VentSettings.Cor_UDi4	X	53		Universal inputs	Connected signal on UDI4: (See signal list for UDI1)
QAnaOut.AQ1	R	54		Analogue outputs	Value of AO1
QAnaOut.AQ2	R	55		Analogue outputs	Value of AO2
QAnaOut.AQ3	R	56		Analogue outputs	Value of AO3
QAnaOut.AQ4	R	57		Analogue outputs	Value of AO4
QAnaOut.AQ5	R	58		Analogue outputs	Value of AO5
VentSettings.Cor_Ao1(0)	X	59		Analogue outputs	Connected signal on AO1: 0=Not used 1=Y1-Heating 2=Y2-Exchanger 3=Y3-Cooling 4=SAF 5=EAF 6=Y6-Humidity 7=Split of Y1, Y2 or Y3 8=Extra unit 9=Heat/Cool (change over) 10=Extra sequence Y4
VentSettings.Cor_Ao2	X	60		Analogue outputs	Connected signal on AO2: (See signal list for AO1)
VentSettings.Cor_Ao3	X	61		Analogue outputs	Connected signal on AO3: (See signal list for AO1)
VentSettings.Cor_Ao4	X	62		Analogue outputs	Connected signal on AO4: (See signal list for AO1)
VentSettings.Cor_Ao5	X	63		Analogue outputs	Connected signal on AO5: (See signal list for AO1)
VentSettings.Cor_Do1(0)	X	64		Digital outputs	Connected signal on DO1: 0 = Not Used

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
					1 = SAFStart1 2 = EAFStart1 3 = SAFStart2 4 = EAFStart2 5 = HeatingPumpStart 6 = ExchangerStart 7 = CoolingPumpStart 8 = FireDamper 9 = SumAlarm 10 = SumAlarmA 11 = SumAlarmB 12 = SAFFrequencyStart 13 = EAFFrequencyStart 14 = HeatingActivate 15 = ExchangerActivate 16 = CoolingActivate 17 = RecycleAirDamper 18 = FreshAirDamper 19 = ExtractAirDamper 20 = HeatingIncrease 21 = HeatingDecrease 22 = ExchangerIncrease 23 = ExchangerDecrease 24 = CoolingIncrease 25 = CoolingDecrease 26 = HeatStep1 27 = HeatStep2 28 = HeatStep3 29 = HeatStep4 30 = CoolStep1 31 = CoolStep2 32 = CoolStep3 33 = TimeChannel1 34 = TimeChannel2 35 = TimeChannel3 36 = TimeChannel4 37 = TimeChannel5 38 = Humidity start 39 = Extra unit start 40 = Heat/Cool step 1 41 = Heat/Cool step 2 42 = Heat/Cool step 3 43 = Night cool run
VentSettings.Cor_Do2	X	65		Digital outputs	Connected signal on DO2: (See signal list for DO1)
VentSettings.Cor_Do3	X	66		Digital outputs	Connected signal on DO3: (See signal list for DO1)
VentSettings.Cor_Do4	X	67		Digital outputs	Connected signal on DO4: (See signal list for DO1)
VentSettings.Cor_Do5	X	68		Digital outputs	Connected signal on DO5: (See signal list for DO1)

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
VentSettings.Cor_Do6	X	69		Digital outputs	Connected signal on DO6: (See signal list for DO1)
VentSettings.Cor_Do7	X	70		Digital outputs	Connected signal on DO7: (See signal list for DO1)
AlaData.AlaPt1_Status	X	71		Alarm Status	Run Error Supply Air Fan 0=Not used 1=Normal 2=Blocked 3=Acknowledge 4=Not used 5=Cancelled 6=Not used 7=Alarm
AlaData.AlaPt2_Status	X	72		Alarm Status	Run Error Extract Air Fan
AlaData.AlaPt3_Status	X	73		Alarm Status	Run Error P1-Heater
AlaData.AlaPt4_Status	X	74		Alarm Status	Run Error P1-Cooler
AlaData.AlaPt5_Status	X	75		Alarm Status	Run Error P1-Exchanger
AlaData.AlaPt6_Status	X	76		Alarm Status	Filter guard
AlaData.AlaPt7_Status	X	77		Alarm Status	Flow guard
AlaData.AlaPt8_Status	X	78		Alarm Status	External frost guard
AlaData.AlaPt9_Status	X	79		Alarm Status	Deicing pressure guard
AlaData.AlaPt10_Status	X	80		Alarm Status	Fire alarm
AlaData.AlaPt11_Status	X	81		Alarm Status	External switch
AlaData.AlaPt12_Status	X	82		Alarm Status	External alarm
AlaData.AlaPt13_Status	X	83		Alarm Status	Supply Air control error
AlaData.AlaPt14_Status	X	84		Alarm Status	Not used
AlaData.AlaPt15_Status	X	85		Alarm Status	High supply air temp
AlaData.AlaPt16_Status	X	86		Alarm Status	Low supply air temp
AlaData.AlaPt17_Status	X	87		Alarm Status	Supply Air Fan max limit
AlaData.AlaPt18_Status	X	88		Alarm Status	Supply Air Fan min limit
AlaData.AlaPt19_Status	X	89		Alarm Status	High room temp
AlaData.AlaPt20_Status	X	90		Alarm Status	Low room temp
AlaData.AlaPt21_Status	X	91		Alarm Status	High extract air temp
AlaData.AlaPt22_Status	X	92		Alarm Status	Low extract air temp
AlaData.AlaPt23_Status	X	93		Alarm Status	Electric heating is overheated
AlaData.AlaPt24_Status	X	94		Alarm Status	Frost risk
AlaData.AlaPt25_Status	X	95		Alarm Status	Low frost guard temp

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
AlaData.AlaPt26_Status	X	96		Alarm Status	Low efficiency
AlaData.AlaPt27_Status	X	97		Alarm Status	Sensor error outdoor temp
AlaData.AlaPt28_Status	X	98		Alarm Status	Analogue deicing
AlaData.AlaPt29_Status	X	99		Alarm Status	Rotation guard exchanger
AlaData.AlaPt30_Status	X	100		Alarm Status	Fire damper is out of operation
AlaData.AlaPt31_Status	X	101		Alarm Status	Supply Air Fan control error
AlaData.AlaPt32_Status	X	102		Alarm Status	Extract Air Fan control error
AlaData.AlaPt33_Status	X	103		Alarm Status	Supply Air Fan external operation
AlaData.AlaPt34_Status	X	104		Alarm Status	Extract Air Fan external operation
AlaData.AlaPt35_Status	X	105		Alarm Status	Ventilation Manual mode
AlaData.AlaPt36_Status	X	106		Alarm Status	Manual supply air control
AlaData.AlaPt37_Status	X	107		Alarm Status	Manual Supply Air Fan mode
AlaData.AlaPt38_Status	X	108		Alarm Status	Manual Supply Air Fan freq control
AlaData.AlaPt39_Status	X	109		Alarm Status	Manual Extract Air Fan mode
AlaData.AlaPt40_Status	X	110		Alarm Status	Manual Extract Air Fan freq control
AlaData.AlaPt41_Status	X	111		Alarm Status	Manual heater control
AlaData.AlaPt42_Status	X	112		Alarm Status	Manual cooler control
AlaData.AlaPt43_Status	X	113		Alarm Status	Manual exchanger control
AlaData.AlaPt44_Status	X	114		Alarm Status	Manual P1-Heater
AlaData.AlaPt45_Status	X	115		Alarm Status	Manual P1-Cooler
AlaData.AlaPt46_Status	X	116		Alarm Status	Manual P1-Exchanger
AlaData.AlaPt47_Status	X	117		Alarm Status	Manual fire damper
AlaData.AlaPt48_Status	X	118		Alarm Status	Internal battery error
VentActual.Cor_HeatCV1(0)	R	119		Supply, Extract and Room temperatures	Control signal heating Y1 (0-10 V)
VentActual.Cor_ExchCV1	R	120		Supply, Extract and Room temperatures	Control signal exchanger Y2 (0-10 V)
VentActual.Cor_CoolCV1	R	121		Supply, Extract and Room temperatures	Control signal cooler Y3 (0-10 V)

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standardwert	Funktion	Beschreibung
VentActual.Cor_SAF	R	122		SAF/EAF Pressure and Flow	Control signal supply air fan (0-10 V)
VentActual.Cor_EAF	R	123		SAF/EAF Pressure and Flow	Control signal extract air fan (0-10 V)
VentActual.Cor_Humidity	R	124		Humidity	Control signal humidity (0-10 V)
VentActual.Cor_Split	R	125		Supply, Extract and Room temperatures	Control signal split (0-10 V)
VentActual.Cor_SupplyPID_Output	R	126		Supply, Extract and Room temperatures	Supply controller output (0-100 %)
VentActual.Cor_ExhaustPID_Output	R	127		Supply, Extract and Room temperatures	Extract controller output (0-100 %)
VentActual.Cor_SAFPID_Output	R	128		SAF/EAF Pressure and Flow	SAF controller output (0-100 %)
VentActual.Cor_EAFPID_Output	R	129		SAF/EAF Pressure and Flow	EAF controller output (0-100 %)
VentActual.Cor_FrostPID_Output	R	130		Frost protection	Frost protection controller output if ventilation unit is stoped (0-100 %)
VentActual.Cor_CO2PID_Output	R	131		CO ₂	CO ₂ controller output (0-100 %)
VentActual.Cor_RoomPID_Output	R	132		Supply, Extract and Room temperatures	Room controller output (0-100 %)
VentActual.Cor_DelcePID_Output	R	133		Extract air temp/De-icing exchanger	De-icing controller output (0-100 %)
VentActual.Cor_HumidityPID_Output	R	134		Humidity	Humidity controller output (0-100 %)
VentActual.Cor_RoomTemp	R	135		Supply, Extract and Room temperatures	Room temperature 1 and 2
AlaData.AlaPt49_Status	X	137		Alarm Status	Sensor error Supply Air temp
AlaData.AlaPt50_Status	X	138		Alarm Status	Sensor error Exhaust Air temp
AlaData.AlaPt51_Status	X	139		Alarm Status	Sensor error Room temp 1
AlaData.AlaPt52_Status	X	140		Alarm Status	Sensor error Room temp 2
AlaData.AlaPt53_Status	X	141		Alarm Status	Sensor error Extract Air temp
AlaData.AlaPt54_Status	X	142		Alarm Status	Sensor error Extra sensor
AlaData.AlaPt55_Status	X	143		Alarm Status	Sensor error SAF pressure
AlaData.AlaPt56_Status	X	144		Alarm Status	Sensor error EAF pressure

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standardwert	Funktion	Beschreibung
AlaData.AlaPt57_Status	X	145		Alarm Status	Sensor error Deicing temp
AlaData.AlaPt58_Status	X	146		Alarm Status	Sensor error Frost Protection temp
AlaData.AlaPt59_Status	X	147		Alarm Status	Sensor error CO ₂
VentActual.Cor_Split	R	125		Supply, Extract and Room temperatures	Control signal split (0-10 V)
VentActual.Cor_SupplyPID_Output	R	126		Supply, Extract and Room temperatures	Supply controller output (0-100 %)
VentActual.Cor_ExhaustPID_Output	R	127		Supply, Extract and Room temperatures	Extract controller output (0-100 %)
VentActual.Cor_SAFPID_Output	R	128		SAF/EAF Pressure and Flow	SAF controller output (0-100 %)
VentActual.Cor_EAFPID_Output	R	129		SAF/EAF Pressure and Flow	EAF controller output (0-100 %)
VentActual.Cor_FrostPID_Output	R	130		Frost protection	Frost protection controller output if ventilation unit is stoped (0-100 %)
VentActual.Cor_CO2PID_Output	R	131		CO ₂	CO ₂ controller output (0-100 %)
VentActual.Cor_RoomPID_Output	R	132		Supply, Extract and Room temperatures	Room controller output (0-100 %)
VentActual.Cor_DelcePID_Output	R	133		Extract air temp/De-icing exchanger	De-icing controller output (0-100 %)
VentActual.Cor_HumidityPID_Output	R	134		Humidity	Humidity controller output (0-100 %)
VentActual.Cor_RoomTemp	R	135		Supply, Extract and Room temperatures	Room temperature 1 and 2
AlaData.AlaPt49_Status	X	137		Alarm Status	Sensor error Supply Air temp
AlaData.AlaPt50_Status	X	138		Alarm Status	Sensor error Exhaust Air temp
AlaData.AlaPt51_Status	X	139		Alarm Status	Sensor error Room temp 1
AlaData.AlaPt52_Status	X	140		Alarm Status	Sensor error Room temp 2
AlaData.AlaPt53_Status	X	141		Alarm Status	Sensor error Extract Air temp
AlaData.AlaPt54_Status	X	142		Alarm Status	Sensor error Extra sensor
AlaData.AlaPt55_Status	X	143		Alarm Status	Sensor error SAF pressure
AlaData.AlaPt56_Status	X	144		Alarm Status	Sensor error EAF pressure

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standardwert	Funktion	Beschreibung
AlaData.AlaPt57_Status	X	145		Alarm Status	Sensor error Deicing temp
AlaData.AlaPt58_Status	X	146		Alarm Status	Sensor error Frost Protection temp
AlaData.AlaPt59_Status	X	147		Alarm Status	Sensor error CO ₂
AlaData.AlaPt60_Status	X	148		Alarm Status	Sensor error Humidity room
AlaData.AlaPt61_Status	X	149		Alarm Status	Sensor error Humidity duct
VentActual.Cor_ExtraUnitTemp(0)	R	150		Extra Unit	Extra Unit temp
VentActual.Cor_ExtSAFControl	R	151		SAF/EAF Pressure and Flow	External SAF signal control (%)
VentActual.Cor_ExtEAFControl	R	152		SAF/EAF Pressure and Flow	External EAF signal control (%)
VentActual.Cor_SAFPressure2	R	153		SAF/EAF Pressure and Flow	Pressure transmitter 2 supply air (Pa)
VentActual.Cor_SAFAirFlow2	R	154		SAF/EAF Pressure and Flow	Counted air flow m3/h supply air 2 airflow = Cor_AirFlowK * Cor_SAFPressure2^Cor_AirFlowx)
VentActual.Cor_HumidityOutdoor	R	155		Humidity	Humidity outdoor
AlaData.AlaPt62_Status	X	156		Alarm Status	Sensor error Extra unit temp
AlaData.AlaPt63_Status	X	157		Alarm Status	Sensor error External control SAF
AlaData.AlaPt64_Status	X	158		Alarm Status	Sensor error External control EAF
AlaData.AlaPt65_Status	X	159		Alarm Status	Sensor error SAF Pressure 2
AlaData.AlaPt66_Status	X	160		Alarm Status	Sensor error Humidity Outdoor
AlaData.AlaPt67_Status	X	161		Alarm Status	Sensor error Reserved 1
AlaData.AlaPt68_Status	X	162		Alarm Status	Sensor error Reserved 2
AlaData.AlaPt69_Status	X	163		Alarm Status	Sensor error Reserved 3
AlaData.AlaPt70_Status	X	164		Alarm Status	Sensor error Reserved 4
AlaData.AlaPt71_Status	X	165		Alarm Status	Sensor error Reserved 5
AlaData.AlaPt72_Status	X	166		Alarm Status	Sensor error Reserved 6
AlaData.AlaPt73_Status	X	167		Alarm Status	Sensor error Reserved 7
AlaData.AlaPt74_Status	X	168		Alarm Status	Sensor error Reserved 8
AlaData.AlaPt75_Status	X	169		Alarm Status	Sensor error Reserved 9

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard- wert	Funktion	Beschreibung
AlaData.AlaPt76_Status	X	170		Alarm Status	Sensor error Reserved 10
AlaData.AlaPt77_Status	X	171		Alarm Status	Alarm Frequency Converter SAF
AlaData.AlaPt78_Status	X	172		Alarm Status	Alarm Frequency Converter EAF
AlaData.AlaPt79_Status	X	173		Alarm Status	Communication error Frequency SAF
AlaData.AlaPt80_Status	X	174		Alarm Status	Communication error Frequency EAF
AlaData.AlaPt81_Status	X	175		Alarm Status	Communication error Expansion unit 1
AlaData.AlaPt82_Status	X	176		Alarm Status	Communication error Expansion unit 2
AlaData.AlaPt83_Status	X	177		Alarm Status	Warning Frequency Converter SAF
AlaData.AlaPt84_Status	X	178		Alarm Status	Warning Frequency Converter EAF
AlaData.AlaPt85_Status	X	179		Alarm Status	Output in manual mode
AlaData.AlaPt86_Status	X	180		Alarm Status	Time for service
AlaData.AlaPt87_Status	X	181		Alarm Status	Manual Y4-Extra Sequence control
VentActual.Cor_ExpAnalogInput(0)	R	182		Analogue inputs	The scaled and filtered value of AI1 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(1)	R	183		Analogue inputs	The scaled and filtered value of AI2 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(2)	R	184		Analogue inputs	The scaled and filtered value of AI3 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(3)	R	185		Analogue inputs	The scaled and filtered value of AI4 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(4)	R	186		Universal inputs	The scaled and filtered value of UAI1 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(5)	R	187		Universal inputs	The scaled and filtered value of UAI2 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(6)	R	188		Universal inputs	The scaled and filtered value of UAI3 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(7)	R	189		Universal inputs	The scaled and filtered value of UAI3 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(8)	R	190		Analogue inputs	The scaled and filtered value of AI1 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(9)	R	191		Analogue inputs	The scaled and filtered value of AI2 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(10)	R	192		Analogue inputs	The scaled and filtered

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
					value of AI3 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(11)	R	193		Analogue inputs	The scaled and filtered value of AI4 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(12)	R	194		Universal inputs	The scaled and filtered value of UAI1 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(13)	R	195		Universal inputs	The scaled and filtered value of UAI2 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(14)	R	196		Universal inputs	The scaled and filtered value of UAI3 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(15)	R	197		Universal inputs	The scaled and filtered value of UAI3 Exp.Unit 2
AlaData.AlaPt86_Status	X	180		Alarm Status	Time for service
AlaData.AlaPt87_Status	X	181		Alarm Status	Manual Y4-Extra Sequence control
VentActual.Cor_ExpAnalogInput(0)	R	182		Analogue inputs	The scaled and filtered value of AI1 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(1)	R	183		Analogue inputs	The scaled and filtered value of AI2 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(2)	R	184		Analogue inputs	The scaled and filtered value of AI3 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(3)	R	185		Analogue inputs	The scaled and filtered value of AI4 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(4)	R	186		Universal inputs	The scaled and filtered value of UAI1 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(5)	R	187		Universal inputs	The scaled and filtered value of UAI2 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(6)	R	188		Universal inputs	The scaled and filtered value of UAI3 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(7)	R	189		Universal inputs	The scaled and filtered value of UAI3 Exp.Unit 1
VentActual.Cor_ExpAnalogInput(8)	R	190		Analogue inputs	The scaled and filtered value of AI1 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(9)	R	191		Analogue inputs	The scaled and filtered value of AI2 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(10)	R	192		Analogue inputs	The scaled and filtered value of AI3 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(11)	R	193		Analogue inputs	The scaled and filtered value of AI4 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(12)	R	194		Universal inputs	The scaled and filtered value of UAI1 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(13)	R	195		Universal inputs	The scaled and filtered value of UAI2 Exp.Unit 2
VentActual.Cor_ExpAnalogInput(14)	R	196		Universal inputs	The scaled and filtered value of UAI3 Exp.Unit 2

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
VentActual.Cor_ExpAnalogInput(15)	R	197		Universal inputs	The scaled and filtered value of UAI3 Exp.Unit 2
VentSettings.Cor_ExpAi(0)	X	198		Analogue inputs	Connected signal on AI1 Exp. Unit 1: 0=Not used 1=Outdoor temp 2=Supply temp 3=Extract temp 4=Room temp1 5=Room temp2 6=Exhaust temp 7=Extrasensor 8=SAF pressure 9=EAF pressure 10=Deicing temp 11=Frost prot. temp 12=CO ₂ 13=Humidity room 14=Humidity duct 15=Extra unit temp 16=External SAF control 17=External EAF control 18=SAF pressure 2 19=Humidity outdoor
VentSettings.Cor_ExpAi(1)	X	199		Analogue inputs	Connected signal on AI2 Exp. Unit 1
VentSettings.Cor_ExpAi(2)	X	200		Analogue inputs	Connected signal on AI3 Exp. Unit 1
VentSettings.Cor_ExpAi(3)	X	201		Analogue inputs	Connected signal on AI4 Exp. Unit 1
VentSettings.Cor_ExpAi(4)	X	202		Analogue inputs	Connected signal on UAI1 Exp. Unit 1
VentSettings.Cor_ExpAi(5)	X	203		Analogue inputs	Connected signal on UAI2 Exp. Unit 1
VentSettings.Cor_ExpAi(6)	X	204		Analogue inputs	Connected signal on UAI3 Exp. Unit 1
VentSettings.Cor_ExpAi(7)	X	205		Analogue inputs	Connected signal on UAI4 Exp. Unit 1
VentSettings.Cor_ExpAi(8)	X	206		Analogue inputs	Connected signal on AI1 Exp. Unit 2
VentSettings.Cor_ExpAi(9)	X	207		Analogue inputs	Connected signal on AI2 Exp. Unit 2
VentSettings.Cor_ExpAi(0)	X	198		Analogue inputs	Connected signal on AI1 Exp. Unit 1: 0=Not used 1=Outdoor temp 2=Supply temp 3=Extract temp 4=Room temp1 5=Room temp2 6=Exhaust temp

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
					7=Extrasensor 8=SAF pressure 9=EAF pressure 10=Deicingtemp 11=Frost prot.temp 12=CO ₂ 13=Humidity room 14=Humidity duct 15=Extra unit temp 16=External SAF control 17=External EAF control 18=SAF pressure 2 19=Humidity outdoor
VentSettings.Cor_ExpAi(1)	X	199		Analogue inputs	Connected signal on AI2 Exp. Unit 1
VentSettings.Cor_ExpAi(2)	X	200		Analogue inputs	Connected signal on AI3 Exp. Unit 1
VentSettings.Cor_ExpAi(3)	X	201		Analogue inputs	Connected signal on AI4 Exp. Unit 1
VentSettings.Cor_ExpAi(4)	X	202		Analogue inputs	Connected signal on UAI1 Exp. Unit 1
VentSettings.Cor_ExpAi(5)	X	203		Analogue inputs	Connected signal on UAI2 Exp. Unit 1
VentSettings.Cor_ExpAi(6)	X	204		Analogue inputs	Connected signal on UAI3 Exp. Unit 1
VentSettings.Cor_ExpAi(7)	X	205		Analogue inputs	Connected signal on UAI4 Exp. Unit 1
VentSettings.Cor_ExpAi(8)	X	206		Analogue inputs	Connected signal on AI1 Exp. Unit 2
VentSettings.Cor_ExpAi(9)	X	207		Analogue inputs	Connected signal on AI2 Exp. Unit 2
VentSettings.Cor_ExpAi(10)	X	208		Analogue inputs	Connected signal on AI3 Exp. Unit 2
VentSettings.Cor_ExpAi(11)	X	209		Analogue inputs	Connected signal on AI4 Exp. Unit 2
VentSettings.Cor_ExpAi(12)	X	210		Analogue inputs	Connected signal on UAI1 Exp. Unit 2
VentSettings.Cor_ExpAi(13)	X	211		Analogue inputs	Connected signal on UAI2 Exp. Unit 2
VentSettings.Cor_ExpAi(14)	X	212		Analogue inputs	Connected signal on UAI3 Exp. Unit 2
VentSettings.Cor_ExpAi(15)	X	213		Analogue inputs	Connected signal on UAI4 Exp. Unit 2
VentSettings.Cor_ExpAi(6)	X	204		Analogue inputs	Connected signal on UAI3 Exp. Unit 1
VentSettings.Cor_ExpAi(7)	X	205		Analogue inputs	Connected signal on UAI4 Exp. Unit 1

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
VentSettings.Cor_ExpAi(8)	X	206		Analogue inputs	Connected signal on AI1 Exp. Unit 2
VentSettings.Cor_ExpAi(9)	X	207		Analogue inputs	Connected signal on AI2 Exp. Unit 2
VentSettings.Cor_ExpAi(10)	X	208		Analogue inputs	Connected signal on AI3 Exp. Unit 2
VentSettings.Cor_ExpAi(11)	X	209		Analogue inputs	Connected signal on AI4 Exp. Unit 2
VentSettings.Cor_ExpAi(12)	X	210		Analogue inputs	Connected signal on UAI1 Exp. Unit 2
VentSettings.Cor_ExpAi(13)	X	211		Analogue inputs	Connected signal on UAI2 Exp. Unit 2
VentSettings.Cor_ExpAi(14)	X	212		Analogue inputs	Connected signal on UAI3 Exp. Unit 2
VentSettings.Cor_ExpAi(15)	X	213		Analogue inputs	Connected signal on UAI4 Exp. Unit 2
VentSettings.Cor_ExpDi(0)	X	214		Digital inputs	Connected signal on DI1 Exp. Unit 1: 0=Not used 1=SAF-Ind 2=EAF-Ind 3=P1-Heating 4=P1-Exchanger 5=P1-Cooling 6=Filter guard 7=Fire alarm 8=Fire damper-ind 9=Ext run 1/1 10=Ext run 1/2 11=External alarm 12=External switch 13=Flow guard 14=Rot.sent.exch 15=De-icing 16=Frostprotection 17=Overheatprotection 18=Recirculation run 19=Change over 20=Filter guard 2
VentSettings.Cor_ExpDi(1)	X	215		Digital inputs	Connected signal on DI2 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(2)	X	216		Digital inputs	Connected signal on DI3 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(3)	X	217		Digital inputs	Connected signal on DI4 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(4)	X	218		Digital inputs	Connected signal on DI5 Exp. Unit 1:

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
					(See signal list for DI1)
VentSettings.Cor_ExpDi(5)	X	219		Digital inputs	Connected signal on DI6 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(6)	X	220		Digital inputs	Connected signal on DI7 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(7)	X	221		Digital inputs	Connected signal on DI8 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(8)	X	222		Digital inputs	Connected signal on UDI1 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(9)	X	223		Digital inputs	Connected signal on UDI2 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(10)	X	224		Digital inputs	Connected signal on UDI3 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(11)	X	225		Digital inputs	Connected signal on UDI4 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(0)	X	214		Digital inputs	Connected signal on DI1 Exp. Unit 1: 0=Not used 1=SAF-Ind 2=EAF-Ind 3=P1-Heating 4=P1-Exchanger 5=P1-Cooling 6=Filter guard 7=Fire alarm 8=Fire damper-ind 9=Ext run 1/1 10=Ext run 1/2 11=External alarm 12=External switch 13=Flow guard 14=Rot.sent.exch 15=De-icing 16=Frostprotection 17=Overheatprotection 18=Recirculation run 19=Change over 20=Filter guard 2
VentSettings.Cor_ExpDi(1)	X	215		Digital inputs	Connected signal on DI2 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(2)	X	216		Digital inputs	Connected signal on DI3 Exp. Unit 1: (See signal list for DI1)

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standardwert	Funktion	Beschreibung
VentSettings.Cor_ExpDi(3)	X	217		Digital inputs	Connected signal on DI4 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(4)	X	218		Digital inputs	Connected signal on DI5 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(5)	X	219		Digital inputs	Connected signal on DI6 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(6)	X	220		Digital inputs	Connected signal on DI7 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(7)	X	221		Digital inputs	Connected signal on DI8 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(8)	X	222		Digital inputs	Connected signal on UDI1 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(9)	X	223		Digital inputs	Connected signal on UDI2 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(10)	X	224		Digital inputs	Connected signal on UDI3 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(11)	X	225		Digital inputs	Connected signal on UDI4 Exp. Unit 1: (See signal list for DI1)
VentSettings.Cor_ExpDi(12)	X	226		Digital inputs	Connected signal on DI1 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(13)	X	227		Digital inputs	Connected signal on DI2 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(14)	X	228		Digital inputs	Connected signal on DI3 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(15)	X	229		Digital inputs	Connected signal on DI4 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(16)	X	230		Digital inputs	Connected signal on DI5 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(17)	X	231		Digital inputs	Connected signal on DI6 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(18)	X	232		Digital inputs	Connected signal on DI7 Exp. Unit 2: (See signal list for DI1)

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
VentSettings.Cor_ExpDi(19)	X	233		Digital inputs	Connected signal on DI8 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(20)	X	234		Digital inputs	Connected signal on UDI1 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(21)	X	235		Digital inputs	Connected signal on UDI2 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(22)	X	236		Digital inputs	Connected signal on UDI3 Exp. Unit 2: (See signal list for DI1)
VentSettings.Cor_ExpDi(23)	X	237		Digital inputs	Connected signal on UDI4 Exp. Unit 2: (See signal list for DI1)
InputOutput.Exp1AnaOut1	R	238		Analogue outputs	Value of AO1 Exp. Unit 1
InputOutput.Exp1AnaOut2	R	239		Analogue outputs	Value of AO2 Exp. Unit 1
InputOutput.Exp1AnaOut3	R	240		Analogue outputs	Value of AO3 Exp. Unit 1
InputOutput.Exp1AnaOut4	R	241		Analogue outputs	Value of AO4 Exp. Unit 1
InputOutput.Exp1AnaOut5	R	242		Analogue outputs	Value of AO5 Exp. Unit 1
InputOutput.Exp2AnaOut1	R	243		Analogue outputs	Value of AO1 Exp. Unit 2
InputOutput.Exp2AnaOut2	R	244		Analogue outputs	Value of AO2 Exp. Unit 2
InputOutput.Exp2AnaOut3	R	245		Analogue outputs	Value of AO3 Exp. Unit 2
InputOutput.Exp2AnaOut4	R	246		Analogue outputs	Value of AO4 Exp. Unit 2
InputOutput.Exp2AnaOut5	R	247		Analogue outputs	Value of AO5 Exp. Unit 2
VentSettings.Cor_ExpAo(0)	X	248		Analogue outputs	Connected signal on AO1 Exp. Unit 1: 0=Not used 1=Y1-Heating 2=Y2-Exchanger 3=Y3-Cooling 4=SAF 5=EAF 6=Y6-Humidity 7=Split of Y1, Y2 or Y3 8=Extra unit 9=Heat/Cool (change over) 10=Extra sequence Y4
VentSettings.Cor_ExpAo(1)	X	249		Analogue outputs	Connected signal on AO2 Exp. Unit 1: (See signal list for AO1)
VentSettings.Cor_ExpAo(2)	X	250		Analogue outputs	Connected signal on AO3 Exp. Unit 1: (See signal list for AO1)
VentSettings.Cor_ExpAo(3)	X	251		Analogue outputs	Connected signal on AO4

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
					Exp. Unit 1: (See signal list for AO1)
VentSettings.Cor_ExpAo(4)	X	252		Analogue outputs	Connected signal on AO5 Exp. Unit 1: (See signal list for AO1)
VentSettings.Cor_ExpAo(5)	X	253		Analogue outputs	Connected signal on AO1 Exp. Unit 2: (See signal list for AO1)
VentSettings.Cor_ExpAo(6)	X	254		Analogue outputs	Connected signal on AO2 Exp. Unit 2: (See signal list for AO1)
VentSettings.Cor_ExpAo(7)	X	255		Analogue outputs	Connected signal on AO3 Exp. Unit 2: (See signal list for AO1)
VentSettings.Cor_ExpAo(8)	X	256		Analogue outputs	Connected signal on AO4 Exp. Unit 2: (See signal list for AO1)
VentSettings.Cor_ExpAo(9)	X	257		Analogue outputs	Connected signal on AO5 Exp. Unit 2: (See signal list for AO1)
VentSettings.Cor_ExpDo(0)	X	258		Digital outputs	Connected signal on DO1 Exp. Unit 1: 0 = Not Used 1 = SAFStart1 2 = EAFStart1 3 = SAFStart2 4 = EAFStart2 5 = HeatingPumpStart 6 = ExchangerStart 7 = CoolingPumpStart 8 = FireDamper 9 = SumAlarm 10 = SumAlarmA 11 = SumAlarmB 12 = SAFFrequencyStart 13 = EAFFrequencyStart 14 = HeatingActivate 15 = ExchangerActivate 16 = CoolingActivate 17 = RecycleAirDamper 18 = FreshAirDamper 19 = ExtractAirDamper 20 = HeatingIncrease 21 = HeatingDecrease 22 = ExchangerIncrease 23 = ExchangerDecrease 24 = CoolingIncrease 25 = CoolingDecrease 26 = HeatStep1 27 = HeatStep2 28 = HeatStep3 29 = HeatStep4 30 = CoolStep1 31 = CoolStep2

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
					32 = CoolStep3 33 = TimeChannel1 34 = TimeChannel2 35 = TimeChannel3 36 = TimeChannel4 37 = TimeChannel5 38 = Humidity start 39 = Extra unit start 40 = Heat/Cool step 1 41 = Heat/Cool step 2 42 = Heat/Cool step 3 43 = Night cool run
VentSettings.Cor_ExpDo(1)	X	259		Digital outputs	Connected signal on DO2 Exp. Unit 1: (See signal list for DO1)
VentSettings.Cor_ExpDo(2)	X	260		Digital outputs	Connected signal on DO3 Exp. Unit 1: (See signal list for DO1)
VentSettings.Cor_ExpDo(3)	X	261		Digital outputs	Connected signal on DO4 Exp. Unit 1: (See signal list for DO1)
VentSettings.Cor_ExpDo(4)	X	262		Digital outputs	Connected signal on DO5 Exp. Unit 1: (See signal list for DO1)
VentSettings.Cor_ExpDo(5)	X	263		Digital outputs	Connected signal on DO6 Exp. Unit 1: (See signal list for DO1)
VentSettings.Cor_ExpDo(6)	X	264		Digital outputs	Connected signal on DO7 Exp. Unit 1: (See signal list for DO1)
VentSettings.Cor_ExpDo(7)	X	265		Digital outputs	Connected signal on DO1 Exp. Unit 2: (See signal list for DO1)
VentSettings.Cor_ExpDo(8)	X	266		Digital outputs	Connected signal on DO2 Exp. Unit 2: (See signal list for DO1)
VentSettings.Cor_ExpDo(9)	X	267		Digital outputs	Connected signal on DO3 Exp. Unit 2: (See signal list for DO1)
VentSettings.Cor_ExpDo(10)	X	268		Digital outputs	Connected signal on DO4 Exp. Unit 2: (See signal list for DO1)
VentSettings.Cor_ExpDo(11)	X	269		Digital outputs	Connected signal on DO5 Exp. Unit 2: (See signal list for DO1)
VentSettings.Cor_ExpDo(12)	X	270		Digital outputs	Connected signal on DO6 Exp. Unit 2: (See signal list for DO1)
VentSettings.Cor_ExpDo(13)	X	271		Digital outputs	Connected signal on DO7 Exp. Unit 2:

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
					(See signal list for DO1)
VentActual.Cor_SAFMotorSpeedHz	R	272		SAF/EAF Pressure and Flow	SAF Motor speed Hz (Vacon)
VentActual.Cor_SAFMotorCurrent	R	273		SAF/EAF Pressure and Flow	SAF Motor current A (Vacon)
VentActual.Cor_SAFMotorPower	R	274		SAF/EAF Pressure and Flow	SAF Motor Power % of nominal (Vacon)
VentActual.Cor_SAFAccumPower	R	275		SAF/EAF Pressure and Flow	SAF Accumulated Power consumption (Vacon)
VentActual.Cor_EAFMotorSpeedHz	R	276		SAF/EAF Pressure and Flow	EAF Motor speed Hz (Vacon)
VentActual.Cor_EAFMotorCurrent	R	277		SAF/EAF Pressure and Flow	EAF Motor current A (Vacon)
VentActual.Cor_EAFMotorPower	R	278		SAF/EAF Pressure and Flow	EAF Motor Power % of nominal (Vacon)
VentActual.Cor_EAFAccumPower	R	279		SAF/EAF Pressure and Flow	EAF Accumulated Power consumption (Vacon)
VentActual.Cor_ExtraUnitCV1(0)	R	280		Extra Unit	Control signal Extra Unit (0-10 V)
VentActual.Cor_ExtraUnitPID1_Output(0)	R	281		Extra Unit	Extra Unit controller output (0-100 %)
VentActual.Cor_HeatCoolCV1	R	282		Supply, Extract and Room temperatures	Control signal Heating or Cooling controlled by changeover (0-10 V)
VentActual.Cor_ExtraSeqCV1	R	283		Supply, Extract and Room temperatures	Control signal extra sequence Y4 (0-10 V)
VentActual.Cor_UnitRunMode	X	284		Actual/Setpoint	Unit run mode: 0=Off 1=Reduced speed 2=Normal speed 3=Stop because of alarm
AlaData.AlaPt88_Status	X	285		Alarm Status	Restart blocked after power-on
VentActual.Cor_IntakeAirTemp	R	286		Actual/Setpoint	Intake air temperature
VentActual.Cor_ExtraSensor2	R	287		Actual/Setpoint	Extrasensor 2 temperature
VentActual.Cor_ExtraSensor3	R	288		Actual/Setpoint	Extrasensor 3 temperature
VentActual.Cor_ExtraSensor4	R	289		Actual/Setpoint	Extrasensor 4 temperature
VentActual.Cor_ExtraSensor5	R	290		Actual/Setpoint	Extrasensor 5 temperature
VentActual.Cor_ExtraSAFPPressure	R	291		SAF/EAF Pressure and Flow	Extrasensor SAF Pressure

Input Register

Variablenname	Variablentyp	Modbus-Adresse	Standard-wert	Funktion	Beschreibung
VentActual.Cor_ExtraEAFPressure	R	292		SAF/EAF Pressure and Flow	Extrasensor EAF Pressure
VentActual.Cor_ExtraSAFAirFlow	R	293		SAF/EAF Pressure and Flow	Extrasensor SAF Flow
VentActual.Cor_ExtraEAFAirFlow	R	294		SAF/EAF Pressure and Flow	Extrasensor EAF Flow
VentActual.Cor_ExtraSensor5	R	290		Actual/Setpoint	Extrasensor 5 temperature
VentActual.Cor_ExtraSAFPPressure	R	291		SAF/EAF Pressure and Flow	Extrasensor SAF Pressure
VentActual.Cor_ExtraEAFPressure	R	292		SAF/EAF Pressure and Flow	Extrasensor EAF Pressure
VentActual.Cor_ExtraSAFAirFlow	R	293		SAF/EAF Pressure and Flow	Extrasensor SAF Flow
VentActual.Cor_ExtraEAFAirFlow	R	294		SAF/EAF Pressure and Flow	Extrasensor EAF Flow

6 Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
VentSettings.Cor_SupplySetpoint	R	1	18°C	Supply, Extract and Room temperatures	Setpoint supply air temperature when constant supply air temperature function
VentSettings.Cor_Curve1_X1	R	2	-20°C	Supply, Extract and Room temperatures	Outdoor temp for first curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_X2	R	3	-15°C	Supply, Extract and Room temperatures	Outdoor temp for second curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_X3	R	4	-10°C	Supply, Extract and Room temperatures	Outdoor temp for third curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_X4	R	5	-5°C	Supply, Extract and Room temperatures	Outdoor temp for fourth curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_X5	R	6	0°C	Supply, Extract and Room temperatures	Outdoor temp for fifth curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_X6	R	7	5°C	Supply, Extract and Room temperatures	Outdoor temp for sixth curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_X7	R	8	10°C	Supply, Extract and Room temperatures	Outdoor temp for seventh curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_X8	R	9	15°C	Supply, Extract and Room temperatures	Outdoor temp for eighth curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_Y1	R	10	25°C	Supply, Extract and Room temperatures	Setpoint for first curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_Y2	R	11	24°C	Supply, Extract and Room temperatures	Setpoint for second curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_Y3	R	12	23°C	Supply, Extract and Room temperatures	Setpoint for third curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_Y4	R	13	23°C	Supply, Extract and Room temperatures	Setpoint for fourth curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_Y5	R	14	22°C	Supply, Extract and Room temperatures	Setpoint for fifth curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_Y6	R	15	20°C	Supply, Extract and	Setpoint for sixth

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
				Room temperatures	curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_Y7	R	16	18°C	Supply, Extract and Room temperatures	Setpoint for seventh curvepoint for outdoor compensated setpoint
VentSettings.Cor_Curve1_Y8	R	17	18°C	Supply, Extract and Room temperatures	Setpoint for eight curvepoint for outdoor compensated setpoint
VentSettings.Cor_ExhaustSetpoint	R	18	21°C	Supply, Extract and Room temperatures	Setpoint extract air temp if extract air temp control function
VentSettings.Cor_RoomSetP	R	19	21°C	Supply, Extract and Room temperatures	Room setpoint if room temp control function
VentSettings.Cor_NeedHeatStart	R	20	15°C	Supply, Extract and Room temperatures	Room temp for start the unit if intermittent heating control is active
VentSettings.Cor_NeedHeatStop	R	21	21°C	Supply, Extract and Room temperatures	Room temp for stop the unit if intermittent heating control is active
VentSettings.Cor_NeedCoolStart	R	22	30°C	Supply, Extract and Room temperatures	Room temp for start the unit if intermittent cooling control is active
VentSettings.Cor_NeedCoolStop	R	23	28°C	Supply, Extract and Room temperatures	Room temp for stop the unit if intermittent cooling control is active
VentSettings.Cor_SAFFullspeed Pressure	R	24	500 Pa	SAF/EAF Pressure and Flow	Setpoint full speed supply air fan pressure
VentSettings.Cor_SAFHalfspeed Pressure	R	25	250 Pa	SAF/EAF Pressure and Flow	Setpoint reduced speed supply air fan pressure
VentSettings.Cor_EAFFullspeed Pressure	R	26	500 Pa	SAF/EAF Pressure and Flow	Setpoint full speed extract air fan pressure
VentSettings.Cor_EAFHalfspeed Pressure	R	27	250 Pa	SAF/EAF Pressure and Flow	Setpoint reduced speed extract air fan pressure
VentSettings.Cor_SAFFullspeed AirFlow	R	28	2000 m ³ /h	SAF/EAF Pressure and Flow	Setpoint full speed supply air fan flow. Scale factor = 1
VentSettings.Cor_SAFHalfspeed AirFlow	R	29	1000 m ³ /h	SAF/EAF Pressure and Flow	Setpoint reduced speed supply air fan flow. Scale factor = 1
VentSettings.Cor_EAFFullspeed AirFlow	R	30	2000 m ³ /h	SAF/EAF Pressure and Flow	Setpoint full speed extract air fan flow. Scale factor = 1
VentSettings.Cor_EAFHalfspeed AirFlow	R	31	1000 m ³ /h	SAF/EAF Pressure and Flow	Setpoint reduced speed extract air fan flow. Scale factor = 1
VentSettings.Cor_CO2Setpoint	R	32	1000 ppm	CO ₂	Setpoint CO ₂

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
VentSettings.Cor_FrostProtSPStop	R	33	25°C	Frost protection	Setpoint frost protection if the ventilation unit is stopped
VentSettings.Cor_FrostProtPGain	R	34	5°C	Frost protection	P-Gain frost protection when running (alarm limit+PGain)
VentSettings.Cor_DelcingSetpoint	R	35	-3°C	Extract air temp/De-icing exchanger	Setpoint de-icing temp
VentSettings.Cor_DelcingHyst	R	36	1°C	Extract air temp/De-icing exchanger	Hysteresis for stop of de-icing
VentSettings.Cor_HumiditySetpoint	R	37	50 % RH	Humidity	Setpoint humidity room
VentSettings.Cor_HumidityMaxDuct	R	38	80 % RH	Humidity	Max limit humidity duct
VentSettings.Cor_HumidityHyst	R	39	20 % RH	Humidity	Hysteresis to start humidity control after stop max limitation
TimeDp.Posts(0).T1	R	40	7	Timer Normal Speed	Start time period 1 Monday normal speed (HH.MM)
TimeDp.Posts(0).T2	R	41	16	Timer Normal Speed	Stop time period 1 Monday normal speed
TimeDp.Posts(0).T3	R	42	0	Timer Normal Speed	Start time period 2 Monday normal speed
TimeDp.Posts(0).T4	R	43	0	Timer Normal Speed	Stop time period 2 Monday normal speed
TimeDp.Posts(1).T1	R	44	7	Timer Normal Speed	Start time period 1 Tuesday normal speed
TimeDp.Posts(1).T2	R	45	16	Timer Normal Speed	Stop time period 1 Tuesday normal speed
TimeDp.Posts(1).T3	R	46	0	Timer Normal Speed	Start time period 2 Tuesday normal speed
TimeDp.Posts(1).T4	R	47	0	Timer Normal Speed	Stop time period 2 Tuesday normal speed
TimeDp.Posts(2).T1	R	48	7	Timer Normal Speed	Start time period 1 Wedn. normal speed
TimeDp.Posts(2).T2	R	49	16	Timer Normal Speed	Stop time period 1 Wedn. normal speed
TimeDp.Posts(2).T3	R	50	0	Timer Normal Speed	Start time period 2 Wedn. normal speed
TimeDp.Posts(2).T4	R	51	0	Timer Normal Speed	Stop time period 2 Wedn. normal speed
TimeDp.Posts(3).T1	R	52	7	Timer Normal Speed	Start time period 1 Thursday normal speed
TimeDp.Posts(3).T2	R	53	16	Timer Normal Speed	Stop time period 1

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
					Thursday normal speed
TimeDp.Posts(3).T3	R	54	0	Timer Normal Speed	Start time period 2 Thursday normal speed
TimeDp.Posts(3).T4	R	55	0	Timer Normal Speed	Stop time period 2 Thursday normal speed
TimeDp.Posts(4).T1	R	56	7	Timer Normal Speed	Start time period 1 Friday normal speed
TimeDp.Posts(4).T2	R	57	16	Timer Normal Speed	Stop time period 1 Friday normal speed
TimeDp.Posts(4).T3	R	58	0	Timer Normal Speed	Start time period 2 Friday normal speed
TimeDp.Posts(4).T4	R	59	0	Timer Normal Speed	Stop time period 2 Friday normal speed
TimeDp.Posts(5).T1	R	60	0	Timer Normal Speed	Start time period 1 Saturday normal speed
TimeDp.Posts(5).T2	R	61	0	Timer Normal Speed	Stop time period 1 Saturday normal speed
TimeDp.Posts(5).T3	R	62	0	Timer Normal Speed	Start time period 2 Saturday normal speed
TimeDp.Posts(5).T4	R	63	0	Timer Normal Speed	Stop time period 2 Saturday normal speed
TimeDp.Posts(6).T1	R	64	0	Timer Normal Speed	Start time period 1 Sunday normal speed
TimeDp.Posts(6).T2	R	65	0	Timer Normal Speed	Stop time period 1 Sunday normal speed
TimeDp.Posts(6).T3	R	66	0	Timer Normal Speed	Start time period 2 Sunday normal speed
TimeDp.Posts(6).T4	R	67	0	Timer Normal Speed	Stop time period 2 Sunday normal speed
TimeDp.Posts(7).T1	R	68	0	Timer Normal Speed	Start time period 1 Holiday normal speed
TimeDp.Posts(7).T2	R	69	0	Timer Normal Speed	Stop time period 1 Holiday normal speed
TimeDp.Posts(7).T3	R	70	0	Timer Normal Speed	Start time period 2 Holiday normal speed
TimeDp.Posts(7).T4	R	71	0	Timer Normal Speed	Stop time period 2 Holiday normal speed
TimeDp.Posts(8).T1	R	72	0	Timer Reduced Speed	Start time period 1 Monday reduced speed (HH.MM)
TimeDp.Posts(8).T2	R	73	0	Timer Reduced Speed	Stop time period 1 Monday reduced speed
TimeDp.Posts(8).T3	R	74	0	Timer Reduced Speed	Start time period 2 Monday reduced speed

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeDp.Posts(8).T4	R	75	0	Timer Reduced Speed	Stop time period 2 Monday reduced speed
TimeDp.Posts(9).T1	R	76	0	Timer Reduced Speed	Start time period 1 Tuesday reduced speed
TimeDp.Posts(9).T2	R	77	0	Timer Reduced Speed	Stop time period 1 Tuesday reduced speed
TimeDp.Posts(9).T3	R	78	0	Timer Reduced Speed	Start time period 2 Tuesday reduced speed
TimeDp.Posts(9).T4	R	79	0	Timer Reduced Speed	Stop time period 2 Tuesday reduced speed
TimeDp.Posts(10).T1	R	80	0	Timer Reduced Speed	Start time period 1 Wedn. reduced speed
TimeDp.Posts(10).T2	R	81	0	Timer Reduced Speed	Stop time period 1 Wedn. reduced speed
TimeDp.Posts(10).T3	R	82	0	Timer Reduced Speed	Start time period 2 Wedn. reduced speed
TimeDp.Posts(10).T4	R	83	0	Timer Reduced Speed	Stop time period 2 Wedn. reduced speed
TimeDp.Posts(11).T1	R	84	0	Timer Reduced Speed	Start time period 1 Thursday red.speed
TimeDp.Posts(11).T2	R	85	0	Timer Reduced Speed	Stop time period 1 Thursday red. speed
TimeDp.Posts(11).T3	R	86	0	Timer Reduced Speed	Start time period 2 Thursday red. speed
TimeDp.Posts(11).T4	R	87	0	Timer Reduced Speed	Stop time period 2 Thursday red. speed
TimeDp.Posts(12).T1	R	88	0	Timer Reduced Speed	Start time period 1 Friday reduced speed
TimeDp.Posts(12).T2	R	89	0	Timer Reduced Speed	Stop time period 1 Friday reduced speed
TimeDp.Posts(12).T3	R	90	0	Timer Reduced Speed	Start time period 2 Friday reduced speed
TimeDp.Posts(12).T4	R	91	0	Timer Reduced Speed	Stop time period 2 Friday reduced speed
TimeDp.Posts(13).T1	R	92	0	Timer Reduced Speed	Start time period 1 Saturday red. speed
TimeDp.Posts(13).T2	R	93	0	Timer Reduced Speed	Stop time period 1 Saturday red. speed
TimeDp.Posts(13).T3	R	94	0	Timer Reduced Speed	Start time period 2 Saturday red. speed
TimeDp.Posts(13).T4	R	95	0	Timer Reduced	Stop time period 2

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
				Speed	Saturday red. speed
TimeDp.Posts(14).T1	R	96	0	Timer Reduced Speed	Start time period 1 Sunday reduced speed
TimeDp.Posts(14).T2	R	97	0	Timer Reduced Speed	Stop time period 1 Sunday reduced speed
TimeDp.Posts(14).T3	R	98	0	Timer Reduced Speed	Start time period 2 Sunday reduced speed
TimeDp.Posts(14).T4	R	99	0	Timer Reduced Speed	Stop time period 2 Sunday reduced speed
TimeDp.Posts(15).T1	R	100	0	Timer Reduced Speed	Start time period 1 Holiday reduced speed
TimeDp.Posts(15).T2	R	101	0	Timer Reduced Speed	Stop time period 1 Holiday reduced speed
TimeDp.Posts(15).T3	R	102	0	Timer Reduced Speed	Start time period 2 Holiday reduced speed
TimeDp.Posts(15).T4	R	103	0	Timer Reduced Speed	Stop time period 2 Holiday reduced speed
TimeDp.Posts(16).T1	R	104	7	Timer Output 1	Start time period 1 Monday timer output 1 (HH.MM)
TimeDp.Posts(16).T2	R	105	16	Timer Output 1	Stop time period 1 Monday timer output 1
TimeDp.Posts(16).T3	R	106	0	Timer Output 1	Start time period 2 Monday timer output 1
TimeDp.Posts(16).T4	R	107	0	Timer Output 1	Stop time period 2 Monday timer output 1
TimeDp.Posts(17).T1	R	108	7	Timer Output 1	Start time period 1 Tuesday timer output 1
TimeDp.Posts(17).T2	R	109	16	Timer Output 1	Stop time period 1 Tuesday timer output 1
TimeDp.Posts(17).T3	R	110	0	Timer Output 1	Start time period 2 Tuesday timer output 1
TimeDp.Posts(17).T4	R	111	0	Timer Output 1	Stop time period 2 Tuesday timer output 1
TimeDp.Posts(18).T1	R	112	7	Timer Output 1	Start time period 1 Wednesd.timer output 1
TimeDp.Posts(18).T2	R	113	16	Timer Output 1	Stop time period 1 Wedn. timer output 1
TimeDp.Posts(18).T3	R	114	0	Timer Output 1	Start time period 2 Wedn. timer output 1
TimeDp.Posts(18).T4	R	115	0	Timer Output 1	Stop time period 2 Wedn. timer output 1
TimeDp.Posts(19).T1	R	116	7	Timer Output 1	Start time period 1 Thursday timer output 1

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeDp.Posts(19).T2	R	117	16	Timer Output 1	Stop time period 1 Thursday timer output 1
TimeDp.Posts(19).T3	R	118	0	Timer Output 1	Start time period 2 Thursday timer output 1
TimeDp.Posts(19).T4	R	119	0	Timer Output 1	Stop time period 2 Thursday timer output 1
TimeDp.Posts(20).T1	R	120	7	Timer Output 1	Start time period 1 Friday timer output 1
TimeDp.Posts(20).T2	R	121	16	Timer Output 1	Stop time period 1 Friday timer output 1
TimeDp.Posts(20).T3	R	122	0	Timer Output 1	Start time period 2 Friday timer output 1
TimeDp.Posts(20).T4	R	123	0	Timer Output 1	Stop time period 2 Friday timer output 1
TimeDp.Posts(21).T1	R	124	0	Timer Output 1	Start time period 1 Saturday timer output 1
TimeDp.Posts(21).T2	R	125	0	Timer Output 1	Stop time period 1 Saturday timer output 1
TimeDp.Posts(21).T3	R	126	0	Timer Output 1	Start time period 2 Saturday timer output 1
TimeDp.Posts(21).T4	R	127	0	Timer Output 1	Stop time period 2 Saturday timer output 1
TimeDp.Posts(22).T1	R	128	0	Timer Output 1	Start time period 1 Sunday timer output 1
TimeDp.Posts(22).T2	R	129	0	Timer Output 1	Stop time period 1 Sunday timer output 1
TimeDp.Posts(22).T3	R	130	0	Timer Output 1	Start time period 2 Sunday timer output 1
TimeDp.Posts(22).T4	R	131	0	Timer Output 1	Stop time period 2 Sunday timer output 1
TimeDp.Posts(23).T1	R	132	0	Timer Output 1	Start time period 1 Holiday timer output 1
TimeDp.Posts(23).T2	R	133	0	Timer Output 1	Stop time period 1 Holiday timer output 1
TimeDp.Posts(23).T3	R	134	0	Timer Output 1	Start time period 2 Holiday timer output 1
TimeDp.Posts(23).T4	R	135	0	Timer Output 1	Stop time period 2 Holiday timer output 1
TimeDp.Posts(24).T1	R	136	7	Timer Output 2	Start time period 1 Monday timer output 2 (HH.MM)
TimeDp.Posts(24).T2	R	137	16	Timer Output 2	Stop time period 1 Monday timer output 2
TimeDp.Posts(24).T3	R	138	0	Timer Output 2	Start time period 2 Monday timer output 2

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeDp.Posts(24).T4	R	139	0	Timer Output 2	Stop time period 2 Monday timer output 2
TimeDp.Posts(25).T1	R	140	7	Timer Output 2	Start time period 1 Tuesday timer output 2
TimeDp.Posts(25).T2	R	141	16	Timer Output 2	Stop time period 1 Tuesday timer output 2
TimeDp.Posts(25).T3	R	142	0	Timer Output 2	Start time period 2 Tuesday timer output 2
TimeDp.Posts(25).T4	R	143	0	Timer Output 2	Stop time period 2 Tuesday timer output 2
TimeDp.Posts(26).T1	R	144	7	Timer Output 2	Start time period 1 Wedn. timer output 2
TimeDp.Posts(26).T2	R	145	16	Timer Output 2	Stop time period 1 Wedn. timer output 2
TimeDp.Posts(26).T3	R	146	0	Timer Output 2	Start time period 2 Wedn. timer output 2
TimeDp.Posts(26).T4	R	147	0	Timer Output 2	Stop time period 2 Wedn. timer output 2
TimeDp.Posts(27).T1	R	148	7	Timer Output 2	Start time period 1 Thursday timer output 2
TimeDp.Posts(27).T2	R	149	16	Timer Output 2	Stop time period 1 Thursday timer output 2
TimeDp.Posts(27).T3	R	150	0	Timer Output 2	Start time period 2 Thursday timer output 2
TimeDp.Posts(27).T4	R	151	0	Timer Output 2	Stop time period 2 Thursday timer output 2
TimeDp.Posts(28).T1	R	152	7	Timer Output 2	Start time period 1 Friday timer output 2
TimeDp.Posts(28).T2	R	153	16	Timer Output 2	Stop time period 1 Friday timer output 2
TimeDp.Posts(28).T3	R	154	0	Timer Output 2	Start time period 2 Friday timer output 2
TimeDp.Posts(28).T4	R	155	0	Timer Output 2	Stop time period 2 Friday timer output 2
TimeDp.Posts(29).T1	R	156	0	Timer Output 2	Start time period 1 Saturday timer output 2
TimeDp.Posts(29).T2	R	157	0	Timer Output 2	Stop time period 1 Saturday timer output 2
TimeDp.Posts(29).T3	R	158	0	Timer Output 2	Start time period 2 Saturday timer output 2
TimeDp.Posts(29).T4	R	159	0	Timer Output 2	Stop time period 2 Saturday timer output 2
TimeDp.Posts(30).T1	R	160	0	Timer Output 2	Start time period 1 Sunday timer output 2

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeDp.Posts(30).T2	R	161	0	Timer Output 2	Stop time period 1 Sunday timer output 2
TimeDp.Posts(30).T3	R	162	0	Timer Output 2	Start time period 2 Sunday timer output 2
TimeDp.Posts(30).T4	R	163	0	Timer Output 2	Stop time period 2 Sunday timer output 2
TimeDp.Posts(31).T1	R	164	0	Timer Output 2	Start time period 1 Holiday timer output 2
TimeDp.Posts(31).T2	R	165	0	Timer Output 2	Stop time period 1 Holiday timer output 2
TimeDp.Posts(31).T3	R	166	0	Timer Output 2	Start time period 2 Holiday timer output 2
TimeDp.Posts(31).T4	R	167	0	Timer Output 2	Stop time period 2 Holiday timer output 2
TimeDp.Posts(32).T1	R	168	7	Timer Output 3	Start time period 1 Monday timer output 3 (HH.MM)
TimeDp.Posts(32).T2	R	169	16	Timer Output 3	Stop time period 1 Monday timer output 3
TimeDp.Posts(32).T3	R	170	0	Timer Output 3	Start time period 2 Monday timer output 3
TimeDp.Posts(32).T4	R	171	0	Timer Output 3	Stop time period 2 Monday timer output 3
TimeDp.Posts(33).T1	R	172	7	Timer Output 3	Start time period 1 Tuesday timer output 3
TimeDp.Posts(33).T2	R	173	16	Timer Output 3	Stop time period 1 Tuesday timer output 3
TimeDp.Posts(33).T3	R	174	0	Timer Output 3	Start time period 2 Tuesday timer output 3
TimeDp.Posts(33).T4	R	175	0	Timer Output 3	Stop time period 2 Tuesday timer output 3
TimeDp.Posts(34).T1	R	176	7	Timer Output 3	Start time period 1 Wedn. timer output 3
TimeDp.Posts(34).T2	R	177	16	Timer Output 3	Stop time period 1 Wedn. timer output 3
TimeDp.Posts(34).T3	R	178	0	Timer Output 3	Start time period 2 Wedn. timer output 3
TimeDp.Posts(34).T4	R	179	0	Timer Output 3	Stop time period 2 Wedn. timer output 3
TimeDp.Posts(35).T1	R	180	7	Timer Output 3	Start time period 1 Thursday timer output 3
TimeDp.Posts(35).T2	R	181	16	Timer Output 3	Stop time period 1 Thursday timer output 3
TimeDp.Posts(35).T3	R	182	0	Timer Output 3	Start time period 2 Thursday timer output 3

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeDp.Posts(35).T4	R	183	0	Timer Output 3	Stop time period 2 Thursday timer output 3
TimeDp.Posts(36).T1	R	184	7	Timer Output 3	Start time period 1 Friday timer output 3
TimeDp.Posts(36).T2	R	185	16	Timer Output 3	Stop time period 1 Friday timer output 3
TimeDp.Posts(36).T3	R	186	0	Timer Output 3	Start time period 2 Friday timer output 3
TimeDp.Posts(36).T4	R	187	0	Timer Output 3	Stop time period 2 Friday timer output 3
TimeDp.Posts(37).T1	R	188	0	Timer Output 3	Start time period 1 Saturday timer output 3
TimeDp.Posts(37).T2	R	189	0	Timer Output 3	Stop time period 1 Saturday timer output 3
TimeDp.Posts(37).T3	R	190	0	Timer Output 3	Start time period 2 Saturday timer output 3
TimeDp.Posts(37).T4	R	191	0	Timer Output 3	Stop time period 2 Saturday timer output 3
TimeDp.Posts(38).T1	R	192	0	Timer Output 3	Start time period 1 Sunday timer output 3
TimeDp.Posts(38).T2	R	193	0	Timer Output 3	Stop time period 1 Sunday timer output 3
TimeDp.Posts(38).T3	R	194	0	Timer Output 3	Start time period 2 Sunday timer output 3
TimeDp.Posts(38).T4	R	195	0	Timer Output 3	Stop time period 2 Sunday timer output 3
TimeDp.Posts(39).T1	R	196	0	Timer Output 3	Start time period 1 Holiday timer output 3
TimeDp.Posts(39).T2	R	197	0	Timer Output 3	Stop time period 1 Holiday timer output 3
TimeDp.Posts(39).T3	R	198	0	Timer Output 3	Start time period 2 Holiday timer output 3
TimeDp.Posts(39).T4	R	199	0	Timer Output 3	Stop time period 2 Holiday timer output 3
TimeDp.Posts(40).T1	R	200	7	Timer Output 4	Start time period 1 Monday timer output 4 (HH.MM)
TimeDp.Posts(40).T2	R	201	16	Timer Output 4	Stop time period 1 Monday timer output 4
TimeDp.Posts(40).T3	R	202	0	Timer Output 4	Start time period 2 Monday timer output 4
TimeDp.Posts(40).T4	R	203	0	Timer Output 4	Stop time period 2 Monday timer output 4
TimeDp.Posts(41).T1	R	204	7	Timer Output 4	Start time period 1 Tuesday timer output 4

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeDp.Posts(41).T2	R	205	16	Timer Output 4	Stop time period 1 Tuesday timer output 4
TimeDp.Posts(41).T3	R	206	0	Timer Output 4	Start time period 2 Tuesday timer output 4
TimeDp.Posts(41).T4	R	207	0	Timer Output 4	Stop time period 2 Tuesday timer output 4
TimeDp.Posts(42).T1	R	208	7	Timer Output 4	Start time period 1 Wedn. timer output 4
TimeDp.Posts(42).T2	R	209	16	Timer Output 4	Stop time period 1 Wedn. timer output 4
TimeDp.Posts(42).T3	R	210	0	Timer Output 4	Start time period 2 Wedn. timer output 4
TimeDp.Posts(42).T4	R	211	0	Timer Output 4	Stop time period 2 Wedn. timer output 4
TimeDp.Posts(43).T1	R	212	7	Timer Output 4	Start time period 1 Thursday timer output 4
TimeDp.Posts(43).T2	R	213	16	Timer Output 4	Stop time period 1 Thursday timer output 4
TimeDp.Posts(43).T3	R	214	0	Timer Output 4	Start time period 2 Thursday timer output 4
TimeDp.Posts(43).T4	R	215	0	Timer Output 4	Stop time period 2 Thursday timer output 4
TimeDp.Posts(44).T1	R	216	7	Timer Output 4	Start time period 1 Friday timer output 4
TimeDp.Posts(44).T2	R	217	16	Timer Output 4	Stop time period 1 Friday timer output 4
TimeDp.Posts(44).T3	R	218	0	Timer Output 4	Start time period 2 Friday timer output 4
TimeDp.Posts(44).T4	R	219	0	Timer Output 4	Stop time period 2 Friday timer output 4
TimeDp.Posts(45).T1	R	220	0	Timer Output 4	Start time period 1 Saturday timer output 4
TimeDp.Posts(45).T2	R	221	0	Timer Output 4	Stop time period 1 Saturday timer output 4
TimeDp.Posts(45).T3	R	222	0	Timer Output 4	Start time period 2 Saturday timer output 4
TimeDp.Posts(45).T4	R	223	0	Timer Output 4	Stop time period 2 Saturday timer output 4
TimeDp.Posts(46).T1	R	224	0	Timer Output 4	Start time period 1 Sunday timer output 4
TimeDp.Posts(46).T2	R	225	0	Timer Output 4	Stop time period 1 Sunday timer output 4
TimeDp.Posts(46).T3	R	226	0	Timer Output 4	Start time period 2 Sunday timer output 4

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeDp.Posts(46).T4	R	227	0	Timer Output 4	Stop time period 2 Sunday timer output 4
TimeDp.Posts(47).T1	R	228	0	Timer Output 4	Start time period 1 Holiday timer output 4
TimeDp.Posts(47).T2	R	229	0	Timer Output 4	Stop time period 1 Holiday timer output 4
TimeDp.Posts(47).T3	R	230	0	Timer Output 4	Start time period 2 Holiday timer output 4
TimeDp.Posts(47).T4	R	231	0	Timer Output 4	Stop time period 2 Holiday timer output 4
TimeDp.Posts(48).T1	R	232	7	Timer Output 5	Start time period 1 Monday timer output 5 (HH.MM)
TimeDp.Posts(48).T2	R	233	16	Timer Output 5	Stop time period 1 Monday timer output 5
TimeDp.Posts(48).T3	R	234	0	Timer Output 5	Start time period 2 Monday timer output 5
TimeDp.Posts(48).T4	R	235	0	Timer Output 5	Stop time period 2 Monday timer output 5
TimeDp.Posts(49).T1	R	236	7	Timer Output 5	Start time period 1 Tuesday timer output 5
TimeDp.Posts(49).T2	R	237	16	Timer Output 5	Stop time period 1 Tuesday timer output 5
TimeDp.Posts(49).T3	R	238	0	Timer Output 5	Start time period 2 Tuesday timer output 5
TimeDp.Posts(49).T4	R	239	0	Timer Output 5	Stop time period 2 Tuesday timer output 5
TimeDp.Posts(50).T1	R	240	7	Timer Output 5	Start time period 1 Wedn. timer output 5
TimeDp.Posts(50).T2	R	241	16	Timer Output 5	Stop time period 1 Wedn. timer output 5
TimeDp.Posts(50).T3	R	242	0	Timer Output 5	Start time period 2 Wedn. timer output 5
TimeDp.Posts(50).T4	R	243	0	Timer Output 5	Stop time period 2 Wedn. timer output 5
TimeDp.Posts(51).T1	R	244	7	Timer Output 5	Start time period 1 Thursday timer output 5
TimeDp.Posts(51).T2	R	245	16	Timer Output 5	Stop time period 1 Thursday timer output 5
TimeDp.Posts(51).T3	R	246	0	Timer Output 5	Start time period 2 Thursday timer output 5
TimeDp.Posts(51).T4	R	247	0	Timer Output 5	Stop time period 2 Thursday timer output 5
TimeDp.Posts(52).T1	R	248	7	Timer Output 5	Start time period 1 Friday timer output 5

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeDp.Posts(52).T2	R	249	16	Timer Output 5	Stop time period 1 Friday timer output 5
TimeDp.Posts(52).T3	R	250	0	Timer Output 5	Start time period 2 Friday timer output 5
TimeDp.Posts(52).T4	R	251	0	Timer Output 5	Stop time period 2 Friday timer output 5
TimeDp.Posts(53).T1	R	252	0	Timer Output 5	Start time period 1 Saturday timer output 5
TimeDp.Posts(53).T2	R	253	0	Timer Output 5	Stop time period 1 Saturday timer output 5
TimeDp.Posts(53).T3	R	254	0	Timer Output 5	Start time period 2 Saturday timer output 5
TimeDp.Posts(53).T4	R	255	0	Timer Output 5	Stop time period 2 Saturday timer output 5
TimeDp.Posts(54).T1	R	256	0	Timer Output 5	Start time period 1 Sunday timer output 5
TimeDp.Posts(54).T2	R	257	0	Timer Output 5	Stop time period 1 Sunday timer output 5
TimeDp.Posts(54).T3	R	258	0	Timer Output 5	Start time period 2 Sunday timer output 5
TimeDp.Posts(54).T4	R	259	0	Timer Output 5	Stop time period 2 Sunday timer output 5
TimeDp.Posts(55).T1	R	260	0	Timer Output 5	Start time period 1 Holiday timer output 5
TimeDp.Posts(55).T2	R	261	0	Timer Output 5	Stop time period 1 Holiday timer output 5
TimeDp.Posts(55).T3	R	262	0	Timer Output 5	Start time period 2 Holiday timer output 5
TimeDp.Posts(55).T4	R	263	0	Timer Output 5	Stop time period 2 Holiday timer output 5
TimeHp.Posts(0).FromDate	R	264	01.01	Holidays	Start date holiday period 1 (MM.DD)
TimeHp.Posts(0).ToDate	R	265	01.01	Holidays	End date holiday period 1 (MM.DD)
TimeHp.Posts(1).FromDate	R	266	01.01	Holidays	Start date holiday period 2 (MM.DD)
TimeHp.Posts(1).ToDate	R	267	01.01	Holidays	End date holiday period 2 (MM.DD)
TimeHp.Posts(2).FromDate	R	268	01.01	Holidays	Start date holiday period 3 (MM.DD)
TimeHp.Posts(2).ToDate	R	269	01.01	Holidays	End date holiday period 3 (MM.DD)
TimeHp.Posts(3).FromDate	R	270	01.01	Holidays	Start date holiday period 4 (MM.DD)

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeHp.Posts(3).ToDate	R	271	01.01	Holidays	End date holiday period 4 (MM.DD)
TimeHp.Posts(4).FromDate	R	272	01.01	Holidays	Start date holiday period 5 (MM.DD)
TimeHp.Posts(4).ToDate	R	273	01.01	Holidays	End date holiday period 5 (MM.DD)
TimeHp.Posts(5).FromDate	R	274	01.01	Holidays	Start date holiday period 6 (MM.DD)
TimeHp.Posts(5).ToDate	R	275	01.01	Holidays	End date holiday period 6 (MM.DD)
TimeHp.Posts(6).FromDate	R	276	01.01	Holidays	Start date holiday period 7 (MM.DD)
TimeHp.Posts(6).ToDate	R	277	01.01	Holidays	End date holiday period 7 (MM.DD)
TimeHp.Posts(7).FromDate	R	278	01.01	Holidays	Start date holiday period 8 (MM.DD)
TimeHp.Posts(7).ToDate	R	279	01.01	Holidays	End date holiday period 8 (MM.DD)
TimeHp.Posts(8).FromDate	R	280	01.01	Holidays	Start date holiday period 9 (MM.DD)
TimeHp.Posts(8).ToDate	R	281	01.01	Holidays	End date holiday period 9 (MM.DD)
TimeHp.Posts(9).FromDate	R	282	01.01	Holidays	Start date holiday period 10 (MM.DD)
TimeHp.Posts(9).ToDate	R	283	01.01	Holidays	End date holiday period 10 (MM.DD)
TimeHp.Posts(10).FromDate	R	284	01.01	Holidays	Start date holiday period 11 (MM.DD)
TimeHp.Posts(10).ToDate	R	285	01.01	Holidays	End date holiday period 11 (MM.DD)
TimeHp.Posts(11).FromDate	R	286	01.01	Holidays	Start date holiday period 12 (MM.DD)
TimeHp.Posts(11).ToDate	R	287	01.01	Holidays	End date holiday period 12 (MM.DD)
TimeHp.Posts(12).FromDate	R	288	01.01	Holidays	Start date holiday period 13 (MM.DD)
TimeHp.Posts(12).ToDate	R	289	01.01	Holidays	End date holiday period 13 (MM.DD)
TimeHp.Posts(13).FromDate	R	290	01.01	Holidays	Start date holiday period 14 (MM.DD)
TimeHp.Posts(13).ToDate	R	291	01.01	Holidays	End date holiday period 14 (MM.DD)
TimeHp.Posts(14).FromDate	R	292	01.01	Holidays	Start date holiday period 15 (MM.DD)

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimeHp.Posts(14).ToDate	R	293	01.01	Holidays	End date holiday period 15 (MM.DD)
TimeHp.Posts(15).FromDate	R	294	01.01	Holidays	Start date holiday period 16 (MM.DD)
TimeHp.Posts(15).ToDate	R	295	01.01	Holidays	End date holiday period 16 (MM.DD)
TimeHp.Posts(16).FromDate	R	296	01.01	Holidays	Start date holiday period 17 (MM.DD)
TimeHp.Posts(16).ToDate	R	297	01.01	Holidays	End date holiday period 17 (MM.DD)
TimeHp.Posts(17).FromDate	R	298	01.01	Holidays	Start date holiday period 18 (MM.DD)
TimeHp.Posts(17).ToDate	R	299	01.01	Holidays	End date holiday period 18 (MM.DD)
TimeHp.Posts(18).FromDate	R	300	01.01	Holidays	Start date holiday period 19 (MM.DD)
TimeHp.Posts(18).ToDate	R	301	01.01	Holidays	End date holiday period 19 (MM.DD)
TimeHp.Posts(19).FromDate	R	302	01.01	Holidays	Start date holiday period 20 (MM.DD)
TimeHp.Posts(19).ToDate	R	303	01.01	Holidays	End date holiday period 20 (MM.DD)
TimeHp.Posts(20).FromDate	R	304	01.01	Holidays	Start date holiday period 21 (MM.DD)
TimeHp.Posts(20).ToDate	R	305	01.01	Holidays	End date holiday period 21 (MM.DD)
TimeHp.Posts(21).FromDate	R	306	01.01	Holidays	Start date holiday period 22 (MM.DD)
TimeHp.Posts(21).ToDate	R	307	01.01	Holidays	End date holiday period 22 (MM.DD)
TimeHp.Posts(22).FromDate	R	308	01.01	Holidays	Start date holiday period 23 (MM.DD)
TimeHp.Posts(22).ToDate	R	309	01.01	Holidays	End date holiday period 23 (MM.DD)
TimeHp.Posts(23).FromDate	R	310	01.01	Holidays	Start date holiday period 24 (MM.DD)
TimeHp.Posts(23).ToDate	R	311	01.01	Holidays	End date holiday period 24 (MM.DD)
VentSettings.Cor_SupplyPID_PGain	R	312	33°C	Settings, Control Temp	P-band supply air control
VentSettings.Cor_SupplyPID_ITime	R	313	100 s	Settings, Control Temp	I-time supply air control
VentSettings.Cor_ExhaustPID_PGain	R	314	100°C	Settings, Control Temp	P-band extract air control

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
VentSettings.Cor_ExhaustPID_ITime	R	315	300 s	Settings, Control Temp	I-time extract air control
VentSettings.Cor_RoomPID_PGain	R	316	100°C	Settings, Control Temp	P-band room air control
VentSettings.Cor_RoomPID_ITime	R	317	300 s	Settings, Control Temp	I-time room air control
VentSettings.Cor_FrostPID_PGain	R	318	100°C	Settings, Control Temp	P-band switchdown mode
VentSettings.Cor_FrostPID_ITime	R	319	100 s	Settings, Control Temp	I-time switchdown mode
VentSettings.Cor_DelcePID_PGain	R	320	100°C	Settings, Control Temp	P-band de-icing
VentSettings.Cor_DelcePID_ITime	R	321	100 s	Settings, Control Temp	I-time de-icing
VentSettings.Cor_SAFPID_PGain	R	322	500 Pa	Settings, Control Pressure	P-band pressure control SAF
VentSettings.Cor_SAFPID_ITime	R	323	60 s	Settings, Control Pressure	I-time pressure control SAF
VentSettings.Cor_EAFPID_PGain	R	324	500 Pa	Settings, Control Pressure	P-band pressure control EAF
VentSettings.Cor_EAFPID_ITime	R	325	60 s	Settings, Control Pressure	I-time pressure control EAF
VentSettings.Cor_SAFAirFlowPID_PGain	R	326	1000 m ³ /h	Settings, Control Flow	P-band flow control SAF
VentSettings.Cor_SAFPID_ITime	R	327	60 s	Settings, Control Flow	I-time flow control SAF
VentSettings.Cor_EAFAirFlowPID_PGain	R	328	1000 m ³ /h	Settings, Control Flow	P-band flow control EAF
VentSettings.Cor_EAFPID_ITime	R	329	60 s	Settings, Control Flow	I-time flow control EAF
VentSettings.Cor_HumidityPID_PGain	R	330	100 % RH	Settings, Control Humidity	P-band humidity control
VentSettings.Cor_HumidityPID_ITime	R	331	300 s	Settings, Control Humidity	I-time humidity control
VentSettings.Cor_SupplyMaxDiff	R	332	10°C	Settings, Alarm Limits	Max control deviation supply air temp
VentSettings.Cor_SupplyHighAlarmLimit	R	333	30°C	Settings, Alarm Limits	High alarm limit supply air temp
VentSettings.Cor_SupplyLowAlarmLimit	R	334	10°C	Settings, Alarm Limits	Low alarm limit supply air temp
VentSettings.Cor_ExhaustAirTempHigh	R	335	30°C	Settings, Alarm Limits	High alarm limit extract air temp
VentSettings.Cor_ExhaustAirTempLow	R	336	10°C	Settings, Alarm Limits	Low alarm limit extract air temp
VentSettings.Cor_RoomHighLimit	R	337	30°C	Settings, Alarm Limits	High alarm limit room air temp

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
VentSettings.Cor_RoomLowLimit	R	338	10°C	Settings, Alarm Limits	Low alarm limit room air temp
VentSettings.Cor_FrostLimit	R	339	7°C	Settings, Alarm Limits	Alarm limit frost protection
VentSettings.Cor_SAFMaxDiffPressure	R	340	50 Pa	Settings, Alarm Limits	Max control deviation pressure SAF
VentSettings.Cor_EAFMaxDiffPressure	R	341	50 Pa	Settings, Alarm Limits	Max control deviation pressure EAF
VentSettings.Cor_EfficiencyLowLimit	R	342	50 %	Settings, Alarm Limits	Low efficiency
AlaData.AlaPt13_DelayValue	I	343	30 min	Settings, Alarm Delays	Alarm delay control deviation supply air temp
AlaData.AlaPt15_DelayValue	I	344	5 s	Settings, Alarm Delays	Alarm delay high supply air temp
AlaData.AlaPt16_DelayValue	I	345	5 s	Settings, Alarm Delays	Alarm delay low supply air temp
AlaData.AlaPt21_DelayValue	I	346	30 min	Settings, Alarm Delays	Alarm delay high extract air temp
AlaData.AlaPt22_DelayValue	I	347	30 min	Settings, Alarm Delays	Alarm delay low extract air temp
AlaData.AlaPt19_DelayValue	I	348	30 min	Settings, Alarm Delays	Alarm delay high room air temp
AlaData.AlaPt20_DelayValue	I	349	30 min	Settings, Alarm Delays	Alarm delay low alarm room air temp
AlaData.AlaPt25_DelayValue	I	350	0 s	Settings, Alarm Delays	Alarm delay frost protection
AlaData.AlaPt31_DelayValue	I	351	30 min	Settings, Alarm Delays	Alarm delay max control deviation pressure SAF
AlaData.AlaPt32_DelayValue	I	352	30 min	Settings, Alarm Delays	Alarm delay max control deviation pressure EAF
AlaData.AlaPt26_DelayValue	I	353	30 min	Settings, Alarm Delays	Alarm delay low efficiency
AlaData.AlaPt1_DelayValue	I	354	120 s	Settings, Alarm Delays	Alarm delay malfunction SAF
AlaData.AlaPt2_DelayValue	I	355	120 s	Settings, Alarm Delays	Alarm delay malfunction EAF
AlaData.AlaPt3_DelayValue	I	356	5 s	Settings, Alarm Delays	Alarm delay malfunction P1-Heating
AlaData.AlaPt4_DelayValue	I	357	5 s	Settings, Alarm Delays	Alarm delay malfunction P1-Cooling
AlaData.AlaPt5_DelayValue	I	358	20 s	Settings, Alarm Delays	Alarm delay malfunction P1-Exchanger

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
AlaData.AlaPt6_DelayValue	I	359	180 s	Settings, Alarm Delays	Alarm delay filter monitoring
AlaData.AlaPt7_DelayValue	I	360	5 s	Settings, Alarm Delays	Alarm delay flow switch
AlaData.AlaPt8_DelayValue	I	361	0 s	Settings, Alarm Delays	Alarm delay frost protection
AlaData.AlaPt9_DelayValue	I	362	0 s	Settings, Alarm Delays	Alarm delay frost protection digital input
AlaData.AlaPt10_DelayValue	I	363	0 s	Settings, Alarm Delays	Alarm delay fire alarm
AlaData.AlaPt12_DelayValue	I	364	0 s	Settings, Alarm Delays	Alarm delay external alarm
AlaData.AlaPt23_DelayValue	I	365	0 s	Settings, Alarm Delays	Alarm delay electric heater
AlaData.AlaPt27_DelayValue	I	366	5 s	Settings, Alarm Delays	Alarm delay sensor error
AlaData.AlaPt29_DelayValue	I	367	20 s	Settings, Alarm Delays	Alarm delay rotation guard exchanger
VentSettings.Cor_AirUnitAutoMode	X	368	3	Manual/Auto	Running mode air unit: 0=Manual off 1=Manual reduced speed 2=Manual normal speed 3=Auto
VentSettings.Cor_SupplyPID_Select	X	369	2	Manual/Auto	Supply temp controller mode: 0=Manual off 1=Manual on 2=Auto
VentSettings.Cor_SupplyPID_ManSet	R	370	0 %	Manual/Auto	Supply temp controller output if manual on mode
VentSettings.Cor_SAFAutoMode(0)	X	371	3	Manual/Auto	Running mode SAF: 0=Off 1=Manual half speed 2=Manual full speed 3=Auto
VentSettings.Cor_EAFAutoMode	X	372	3	Manual/Auto	Running mode EAF: 0=Off 1=Manual half speed 2=Manual full speed 3=Auto
VentSettings.Cor_SAFFrequencyAutoMode	X	373	3	Manual/Auto	Running mode frequency controlled SAF 0=Manual 1=Man. half speed 2=Man. Fullspeed

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
					3=Auto
VentSettings.Cor_SAFManual	R	374	0 %	Manual/Auto	Freguencer controller output SAF if manual mode
VentSettings.Cor_EAFFrequence AutoMode	X	375	3	Manual/Auto	Running mode frequence controlled EAF 0=Manual 1=Man. half speed 2=Man. Fullspeed 3=Auto
VentSettings.Cor_EAFManual	R	376	0 %	Manual/Auto	Freguencer controller output EAF if manual mode
VentSettings.Cor_HeatCoilAuto Mode(0)	X	377	2	Manual/Auto	Running mode Heating: 0=Off 1=Manual 2=Auto
VentSettings.Cor_HeatCoilManual (0)	R	378	0	Manual/Auto	Heating controller output if manual mode
VentSettings.Cor_ExchCoilAuto Mode	X	379	2	Manual/Auto	Running mode Exchanger: 0=Off 1=Manual 2=Auto
VentSettings.Cor_ExchCoilManual	R	380	0	Manual/Auto	Exchanger controller output if manual mode
VentSettings.Cor_CoolCoilAuto Mode	X	381	2	Manual/Auto	Running mode Cooling: 0=Off 1=Manual 2=Auto
VentSettings.Cor_CoolCoilManual	R	382	0	Manual/Auto	Cooling controller output if manual mode
VentSettings.Cor_HumidityPID_ Select	X	383	2	Manual/Auto	Running mode Humidification/Dehumidification: 0=Off 1=Manual 2=Auto
VentSettings.Cor_HumidityPID_ ManSet	R	384	0	Manual/Auto	Humidification/Dehumidification controller output if manual mode
VentSettings.Cor_HeatPumpAuto Mode(0)	X	385	2	Manual/Auto	Running mode P1- Heating: 0=Manual off 1=Manual on 2=Auto
VentSettings.Cor_ExchPumpAuto Mode	X	386	2	Manual/Auto	Running mode P1- Exchanger: 0=Manual off

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
					1=Manual on 2=Auto
VentSettings.Cor_CoolPumpAuto Mode	X	387	2	Manual/Auto	Running mode P1-Cooling: 0=Manual off 1=Manual on 2=Auto
VentSettings.Cor_FireDamperAuto Mode	X	388	2	Manual/Auto	Running mode fire damper: 0=Close 1=Open 2=Auto
VentSettings.Cor_FreshAirDamper AutoMode	X	389	2	Manual/Auto	Running mode fresh air damper: 0=Close 1=Open 2=Auto
VentSettings.Cor_RecycleAirDamper AutoMode	X	390	2	Manual/Auto	Running mode recirculation damper: 0=Close 1=Open 2=Auto
VentSettings.Cor_ExtractAirDamper AutoMode	X	391	2	Manual/Auto	Running mode extract air damper: 0=Close 1=Open 2=Auto
VentActual.Cor_OutDoorTemp(0)	R	392		Actual/Setpoint	Outdoor temperature (Can be modified if it's not connected to a physic analogue input).
TimePro. TimeGroupStatusFanFullSpeed	X	393	4	Manual/Auto	Manual/Auto Full Speed time channel 0=Manual-Off 1=Manual-On 2=Forced Off 3=Forced On 4=Auto
TimePro. TimeGroupStatusFanHalfSpeed	X	394	4	Manual/Auto	Manual/Auto Half Speed time channel 0=Manual-Off 1=Manual-On 2=Forced Off 3=Forced On 4=Auto
TimePro. TimeGroupStatusCor_ExtraTime Group1	X	395	4	Manual/Auto	Manual/Auto Timer output 1
TimePro. TimeGroupStatusCor_ExtraTime Group2	X	396	4	Manual/Auto	Manual/Auto Timer output 2 0=Manual-Off 1=Manual-On

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
					2=Forced Off 3=Forced On 4=Auto
TimePro. TimeGroupStatusCor_ExtraTime Group3	X	397	4	Manual/Auto	Manual/Auto Timer output 3
TimePro. TimeGroupStatusCor_ExtraTime Group4	X	398	4	Manual/Auto	Manual/Auto Timer output 4 0=Manual-Off 1=Manual-On 2=Forced Off 3=Forced On 4=Auto
TimePro. TimeGroupStatusCor_ExtraTime Group5	X	399	4	Manual/Auto	Manual/Auto Timer output 5
Alarms.AlaAcknow	X	400	255	Alarm Acknowledging, Blocking and Unblocking	External alarm acknowledge by setting this signal to the alarm number that should be acknowledge.
Alarms.AlaBlock	X	401	255	Alarm Acknowledging, Blocking and Unblocking	External alarm blocking by setting this signal to the alarm number that should be blocked.
Alarms.AlaUnBlock	X	402	255	Alarm Acknowledging, Blocking and Unblocking	External alarm unblocking by setting this signal to the alarm number that should be unblocked.
VentSettings.Cor_HeatPumpLimit	R	403	10°C	Actual/Setpoint	If lower outdoor temp the heating pump is not stoped
VentSettings.Cor_SupplySetpoint Max	R	404	30°C	Supply,Extract and Room temperatures	Max limit of supply setpoint when cascade control
VentSettings.Cor_SupplySetpoint Min	R	405	12°C	Supply,Extract and Room temperatures	Min limit of supply setpoint when cascade control
QSystem.Sec	X	406		Real Time Clock	Real time clock: Second 0-59
QSystem.Minute	X	407		Real Time Clock	Real time clock: Minute 0-59
QSystem.Hour	X	408		Real Time Clock	Real time clock: Hour 0- 23
QSystem.WDay	X	409		Real Time Clock	Real time clock: Day of Week 1-7, 1=Monday
QSystem.Week	X	410		Real Time Clock	Real time clock: Week number 1-53

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
QSystem.Date	X	411		Real Time Clock	Real time clock: Day of month 1-31
QSystem.Month	X	412		Real Time Clock	Real time clock: Month 1-12
QSystem.Year	X	413		Real Time Clock	Real time clock: Year 0-99
VentSettings.Cor_Comp1Pressure	R	414	0	SAF/EAF Pressure and Flow	Pressure compensation at breakpoint 1
VentSettings. Cor_Comp1Temp	R	415	-20	SAF/EAF Pressure and Flow	Outdoor temp breakpoint 1 (must be lower than breakpoint 2 temp)
VentSettings.Cor_Comp2Pressure	R	416	0	SAF/EAF Pressure and Flow	Pressure compensation at breakpoint 2
VentSettings.Cor_Comp2Temp	R	417	10	SAF/EAF Pressure and Flow	Outdoor temp breakpoint 2 (must be higher than breakpoint 1 temp)
VentSettings.Cor_HumidityMaxDiff	R	418	10 % RH	Humidity	Max allowed difference between setpoint and humidity in room before alarm
VentSettings.Cor_HumidityStartLimit	R	419	15 % RH	Humidity	Start limit in % to start digital output signal "Cor_HumidityStart(0)"
VentSettings.Cor_HumidityStopLimit	R	420	5 % RH	Humidity	Stop limit in % to stop digital output signal "Cor_HumidityStart(0)"
VentSettings.Cor_HumidityAuto Mode	X	421	2	Manual/Auto	Running mode humidity start signal 0=Off 1=On 2=Auto
VentSettings.Cor_ExchStartDelay	I	422	0 s	Settings, General	Start delay Exchanger (s)
VentSettings.Cor_DXBlockLimit	R	423	0°C	Settings, General	If lower outdoor temperature all steps for DX-cooling is blocked
VentSettings.Cor_SAFFullspeed Output	R	424	75 %	SAF/EAF Pressure and Flow	Output signal (0-100%) full speed SAF if Frequency control manually
VentSettings.Cor_SAFHalfspeed Output	R	425	50 %	SAF/EAF Pressure and Flow	Output signal (0-100%) half speed SAF if Frequency control manually
VentSettings.Cor_EAFFullspeed Output	R	426	75 %	SAF/EAF Pressure and Flow	Output signal (0-100%) full speed EAF if

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
					Frequency control manually
VentSettings.Cor_EAFHalfspeed Output	R	427	50 %	SAF/EAF Pressure and Flow	Output signal (0-100%) half speed EAF if Frequency control manually
VentSettings.Cor_CoolStepBlock1	R	428	0 %	Settings, General	If frequens output signal SAF is lower cool step 1 is blocked
VentSettings.Cor_CoolStepBlock2	R	429	0 %	Settings, General	If frequens output signal SAF is lower cool step 2 is blocked
VentSettings.Cor_CoolStepBlock3	R	430	0 %	Settings, General	If frequens output signal SAF is lower cool step 3 is blocked
VentSettings.Cor_CoolStepBlockLimit1(0)	R	431	13°C	Settings, General	If lower outdoor temperature Cool step 1 is blocked
VentSettings.Cor_CoolStepBlockLimit2	R	432	13°C	Settings, General	If lower outdoor temperature Cool step 2 is blocked
VentSettings.Cor_CoolStepBlockLimit3	R	433	13°C	Settings, General	If lower outdoor temperature Cool step 3 is blocked
VentSettings.Cor_ExtraUnitFunc	X	434	0	Extra Unit	Start/Stop function Extra Unit: 0=Off 1=Always running 2=Running if unit is running
VentSettings.Cor_ExtraUnitSetP	R	435	18°C	Extra Unit	Setpoint Extra Unit
VentSettings.Cor_ExtraUnitPID1Mode	X	436	0	Extra Unit	Control mode Extra Unit 0=Heating Controller 1=Cooling Controller
VentSettings.Cor_ExtraUnitPID1_Select(0)	X	437	2	Manual/Auto	Manual/Auto Extra Unit Controller 0=Off 1=Manual 2=Auto
VentSettings.Cor_ExtraUnitPID1_ManSet(0)	R	438	0	Manual/Auto	Extra Unit Controller output if manual mode
VentSettings.Cor_RecycleSetP	R	439	18°C	Recirculation	Recirculation setpoint
VentSettings.Cor_RecycleMaxRoomTemp	R	440	25°C	Recirculation	If higher room temp when Recirculation run recirculation damper is closed and fresh air damper is open
VentSettings.Cor_RecycleSAF Offset	R	441	0	Recirculation	Setpoint offset if pressure/flow controlled

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
					SAF (Pa)
VentSettings.Cor_RecycleEAF Offset	R	442	0	Recirculation	Setpoint offset if pressure/flow controlled EAF (this is not used)
VentSettings.Cor_SAFAirFlowK	R	443	100	SAF/EAF Pressure and Flow	K-constant for counting air flow SAF airflow = Cor_AirFlowK * Cor_SAFPressure^Cor_AirFlowx
VentSettings.Cor_SAFAirFlowx	R	444	0.5	SAF/EAF Pressure and Flow	X-constant for counting air flow SAF
VentSettings.Cor_EAFAirFlowK	R	445	100	SAF/EAF Pressure and Flow	K-constant for counting air flow EAF airflow = Cor_AirFlowK * Cor_SAFPressure^Cor_AirFlowx
VentSettings.Cor_EAFAirFlowx	R	446	0.5	SAF/EAF Pressure and Flow	X-constant for counting air flow EAF
VentSettings.Cor_EAFFrequency Fact	R	447	1	SAF/EAF Pressure and Flow	Factor for controlling EAF if CAV fan control is configured (EAF is controlled by SAF with this factor)
VentSettings.Cor_ExtraSeqCoil AutoMode	X	448	2	Manual/Auto	Manual/Auto Extra Sequence Y4 0=Off 1=Manual 2=Auto
VentSettings.Cor_ExtraSeqCoil Manual	R	449	0	Manual/Auto	Extra Sequence Y4 output if manual mode
VentSettings.Cor_FilterAlarmTime	I	450	0	Settings, Alarm Delays	Time in month between filter exchange (Service Alarm)
VentSettings.Cor_ExternalControl	X	451	2	Manual/Auto	External control: 0=Extended run full speed 1=External stop 2=No external control 3=External stop with support control
VentSettings.Cor_PreHeatStart	R	452	8	Settings, PreTreatment	If outdoor temp. is lower, preheat is activated
VentSettings.Cor_PreCoolStart	R	453	19	Settings, PreTreatment	If outdoor temp. is higher, precool is activated
VentSettings.Cor_PreTreatHyst	R	454	1	Settings, PreTreatment	Hysteresis to start/stop pretreatment

Holding Register

Variable name	Variable type	Modbus address	Default value	Function	Description
VentSettings.Cor_PreTreatMinDiff	R	455	1	Settings, PreTreatment	Min. diff. intake air temp. and outdoor air temp.
VentSettings.Cor_PreTreatment AutoMode	X	456	2	Settings, PreTreatment	Run mode pretreatment: 0=Closed 1=Open 2=Auto
VentSettings.Cor_PreTreatFreeCool	X	457	0	Settings, PreTreatment	Select if pretreatment should be activated during free cooling
VentSettings.Cor_PreTreatBlock Time	X	458	6	Settings, PreTreatment	Hour that pretreatment is blocked if diff. intake/outdoor is too low
VentSettings.Cor_PreTreatMinRun Time	X	459	5	Settings, PreTreatment	Min. runtime (minutes) for pretreatment
VentSettings.Cor_RestartPowerOn	X	460	1	Settings, General	Automatic restart after power-up (=1)
VentSettings.Cor_DXFullSpeed	X	461	0	Settings, General	Switch to full speed if DX-Cooling
VentSettings.Cor_RecycleSetPOffset	R	462	0	Recirculation	Offset for recirculation setpoint
VentSettings.Cor_RecycleSetP Control	X	463	0	Recirculation	Select if constant setpoint or setpoint adjustment when recirculation run: 0=Constant setpoint 1=Supply air setpoint with adjustment
VentSettings.Cor_RecycleTemp Control	X	464	0	Recirculation	Enable supply air temp control when recirculation run: 0=No temp control 1=heating/cooling 2=only heating 3=only cooling

Input Status Register

7 Input Status Register

Variable name	Variable type	Modbus address	Default value	Function	Description
TimePro.TimeGroupFanFullSpeed	L	1		Actual/Setpoint	Is set if timechannel full speed is active
TimePro.TimeGroupFanHalfSpeed	L	2		Actual/Setpoint	Is set if timechannel reduced speed is active
TimePro.TimeGroupCor_ExtraTime Group1	L	3		Actual/Setpoint	Is set if timer output 1 is active
TimePro.TimeGroupCor_ExtraTime Group2	L	4		Actual/Setpoint	Is set if timer output 2 is active
TimePro.TimeGroupCor_ExtraTime Group3	L	5		Actual/Setpoint	Is set if timer output 3 is active
TimePro.TimeGroupCor_ExtraTime Group4	L	6		Actual/Setpoint	Is set if timer output 4 is active
TimePro.TimeGroupCor_ExtraTime Group5	L	7		Actual/Setpoint	Is set if timer output 5 is active
VentActual.Cor_ExtendedRunActiveFull	L	8		Actual/Setpoint	Is set if extended operation full speed
VentActual.Cor_ExtendedRunActiveHalf	L	9		Actual/Setpoint	Is set if extended operation half speed
VentActual.Cor_NeedHeatActive	L	10		Supply,Extract and Room temperatures	Is set if ongoing support heating
VentActual. Cor_NeedCoolActive	L	11		Supply,Extract and Room temperatures	Is set if ongoing support cooling
VentActual.Cor_DemandCO2Active	L	12		CO ₂	Is set if ongoing support CO ₂
VentActual.Cor_DelcingActive	L	13		Extract air temp/ Deicing exchanger	Is set if ongoing de-icing
QDig.DI1	L	14		Digital inputs	Value of DI1
QDig.DI2	L	15		Digital inputs	Value of DI2
QDig.DI3	L	16		Digital inputs	Value of DI3
QDig.DI4	L	17		Digital inputs	Value of DI4
QDig.DI5	L	18		Digital inputs	Value of DI5
QDig.DI6	L	19		Digital inputs	Value of DI6
QDig.DI7	L	20		Digital inputs	Value of DI7
QDig.DI8	L	21		Digital inputs	Value of DI8
QDig.DI9	L	22		Universal inputs	Value of UDI1
QDig.DI10	L	23		Universal inputs	Value of UDI2
QDig.DI11	L	24		Universal inputs	Value of UDI3

Input Status Register

Variable name	Variable type	Modbus address	Default value	Function	Description
QDig.DI12	L	25		Universal inputs	Value of UDI4
QDig.Dq1	L	26		Digital outputs	Value of DO1
QDig.Dq2	L	27		Digital outputs	Value of DO2
QDig.Dq3	L	28		Digital outputs	Value of DO3
QDig.Dq4	L	29		Digital outputs	Value of DO4
QDig.Dq5	L	30		Digital outputs	Value of DO5
QDig.Dq6	L	31		Digital outputs	Value of DO6
QDig.Dq7	L	32		Digital outputs	Value of DO7
VentActual.Cor_AlaPt(1)	L	33		Alarm Points	Run Error Supply Air Fan 0=No alarm 1=Alarm
VentActual.Cor_AlaPt(2)	L	34		Alarm Points	Run Error Extract Air Fan
VentActual.Cor_AlaPt(3)	L	35		Alarm Points	Run Error P1-Heater
VentActual.Cor_AlaPt(4)	L	36		Alarm Points	Run Error P1-Cooler
VentActual.Cor_AlaPt(5)	L	37		Alarm Points	Run Error P1-Exchanger
VentActual.Cor_AlaPt(6)	L	38		Alarm Points	Filter guard
VentActual.Cor_AlaPt(7)	L	39		Alarm Points	Flow guard
VentActual.Cor_AlaPt(8)	L	40		Alarm Points	External frost guard
VentActual.Cor_AlaPt(9)	L	41		Alarm Points	Deicing pressure guard
VentActual.Cor_AlaPt(10)	L	42		Alarm Points	Fire alarm
VentActual.Cor_AlaPt(11)	L	43		Alarm Points	External switch
VentActual.Cor_AlaPt(12)	L	44		Alarm Points	External alarm
VentActual.Cor_AlaPt(13)	L	45		Alarm Points	Supply Air control error
VentActual.Cor_AlaPt(14)	L	46		Alarm Points	Deviation Humidity control
VentActual.Cor_AlaPt(15)	L	47		Alarm Points	High supply air temp
VentActual.Cor_AlaPt(16)	L	48		Alarm Points	Low supply air temp
VentActual.Cor_AlaPt(17)	L	49		Alarm Points	Supply Air Fan max limit
VentActual.Cor_AlaPt(18)	L	50		Alarm Points	Supply Air Fan min limit
VentActual.Cor_AlaPt(19)	L	51		Alarm Points	High room temp
VentActual.Cor_AlaPt(20)	L	52		Alarm Points	Low room temp
VentActual.Cor_AlaPt(21)	L	53		Alarm Points	High extract air temp
VentActual.Cor_AlaPt(22)	L	54		Alarm Points	Low extract air temp
VentActual.Cor_AlaPt(23)	L	55		Alarm Points	Electric heating is overheated
VentActual.Cor_AlaPt(24)	L	56		Alarm Points	Frost risk

Input Status Register

Variable name	Variable type	Modbus address	Default value	Function	Description
VentActual.Cor_AlaPt(25)	L	57		Alarm Points	Low frost guard temp
VentActual.Cor_AlaPt(26)	L	58		Alarm Points	Low efficiency
VentActual.Cor_AlaPt(27)	L	59		Alarm Points	Sensor error outdoor temp
VentActual.Cor_AlaPt(28)	L	60		Alarm Points	Analogue deicing
VentActual.Cor_AlaPt(29)	L	61		Alarm Points	Rotation guard exchanger
VentActual.Cor_AlaPt(30)	L	62		Alarm Points	Fire damper is out of operation
VentActual.Cor_AlaPt(31)	L	63		Alarm Points	Supply Air Fan control error
VentActual.Cor_AlaPt(32)	L	64		Alarm Points	Extract Air Fan control error
VentActual.Cor_AlaPt(33)	L	65		Alarm Points	Supply Air Fan external operation
VentActual.Cor_AlaPt(34)	L	66		Alarm Points	Extract Air Fan external operation
VentActual.Cor_AlaPt(35)	L	67		Alarm Points	Ventilation Manual mode
VentActual.Cor_AlaPt(36)	L	68		Alarm Points	Manual supply air control
VentActual.Cor_AlaPt(37)	L	69		Alarm Points	Manual Supply Air Fan mode
VentActual.Cor_AlaPt(38)	L	70		Alarm Points	Manual Supply Air Fan freq control
VentActual.Cor_AlaPt(39)	L	71		Alarm Points	Manual Extract Air Fan mode
VentActual.Cor_AlaPt(40)	L	72		Alarm Points	Manual Extract Air Fan freq control
VentActual.Cor_AlaPt(41)	L	73		Alarm Points	Manual heater control
VentActual.Cor_AlaPt(42)	L	74		Alarm Points	Manual cooler control
VentActual.Cor_AlaPt(43)	L	75		Alarm Points	Manual exchanger control
VentActual.Cor_AlaPt(44)	L	76		Alarm Points	Manual P1-Heater
VentActual.Cor_AlaPt(45)	L	77		Alarm Points	Manual P1-Cooler
VentActual.Cor_AlaPt(46)	L	78		Alarm Points	Manual P1-Exchanger
VentActual.Cor_AlaPt(47)	L	79		Alarm Points	Manual fire damper
VentActual.Cor_AlaPt(48)	L	80		Alarm Points	Internal battery error
VentActual.Cor_SAFStart1(0)	L	81		SAF/EAF Pressure and Flow	Start signal full speed supply air fan
VentActual.Cor_EAFStart1	L	82		SAF/EAF Pressure and Flow	Start signal full speed extract air fan

Input Status Register

Variable name	Variable type	Modbus address	Default value	Function	Description
VentActual.Cor_SAFStart2	L	83		SAF/EAF Pressure and Flow	Start signal half speed supply air fan
VentActual.Cor_EAFStart2	L	84		SAF/EAF Pressure and Flow	Start signal half speed extract air fan
VentActual.Cor_HeatPumpStart(0)	L	85		Actual/Setpoint	Start signal Heat Pump
VentActual.Cor_ExchPumpStart	L	86		Actual/Setpoint	Start signal Exchanger
VentActual.Cor_CoolPumpStart	L	87		Actual/Setpoint	Start signal Cool Pump
VentActual.Cor_SAFFrequencyStart	L	88		SAF/EAF Pressure and Flow	Start signal frequencer supply air fan
VentActual.Cor_EAFFrequencyStart	L	89		SAF/EAF Pressure and Flow	Start signal frequencer extract air fan
VentActual.Cor_AlaPt(49)	L	90		Alarm Points	Sensor error Supply Air temp
VentActual.Cor_AlaPt(50)	L	91		Alarm Points	Sensor error Extract Air temp
VentActual.Cor_AlaPt(51)	L	92		Alarm Points	Sensor error Room temp 1
VentActual.Cor_AlaPt(52)	L	93		Alarm Points	Sensor error Room temp 2
VentActual.Cor_AlaPt(53)	L	94		Alarm Points	Sensor error Extract Air temp
VentActual.Cor_AlaPt(54)	L	95		Alarm Points	Sensor error Extra sensor
VentActual.Cor_AlaPt(55)	L	96		Alarm Points	Sensor error SAF pressure
VentActual.Cor_AlaPt(56)	L	97		Alarm Points	Sensor error EAF pressure
VentActual.Cor_AlaPt(57)	L	98		Alarm Points	Sensor error Deicing temp
VentActual.Cor_AlaPt(58)	L	99		Alarm Points	Sensor error Frost Protection temp
VentActual.Cor_AlaPt(59)	L	100		Alarm Points	Sensor error CO ₂
VentActual.Cor_AlaPt(60)	L	101		Alarm Points	Sensor error Humidity room
VentActual.Cor_AlaPt(61)	L	102		Alarm Points	Sensor error Humidity duct
VentActual.Cor_AlaPt(62)	L	103		Alarm Points	Sensor error Extra unit temp
VentActual.Cor_AlaPt(63)	L	104		Alarm Points	Sensor error External control SAF
VentActual.Cor_AlaPt(64)	L	105		Alarm Points	Sensor error External control EAF
VentActual.Cor_AlaPt(65)	L	106		Alarm Points	Sensor error SAF

Input Status Register

Variable name	Variable type	Modbus address	Default value	Function	Description
					Pressure 2
VentActual.Cor_AlaPt(66)	L	107		Alarm Points	Sensor error Humidity Outdoor
VentActual.Cor_AlaPt(67)	L	108		Alarm Points	Sensor error Reserved 1
VentActual.Cor_AlaPt(68)	L	109		Alarm Points	Sensor error Reserved 2
VentActual.Cor_AlaPt(69)	L	110		Alarm Points	Sensor error Reserved 3
VentActual.Cor_AlaPt(70)	L	111		Alarm Points	Sensor error Reserved 4
VentActual.Cor_AlaPt(71)	L	112		Alarm Points	Sensor error Reserved 5
VentActual.Cor_AlaPt(72)	L	113		Alarm Points	Sensor error Reserved 6
VentActual.Cor_AlaPt(73)	L	114		Alarm Points	Sensor error Reserved 7
VentActual.Cor_AlaPt(74)	L	115		Alarm Points	Sensor error Reserved 8
VentActual.Cor_AlaPt(75)	L	116		Alarm Points	Sensor error Reserved 9
VentActual.Cor_AlaPt(76)	L	117		Alarm Points	Sensor error Reserved 10
VentActual.Cor_AlaPt(77)	L	118		Alarm Points	Alarm Frequency Converter SAF
VentActual.Cor_AlaPt(78)	L	119		Alarm Points	Alarm Frequency Converter EAF
VentActual.Cor_AlaPt(79)	L	120		Alarm Points	Communication error Frequency SAF
VentActual.Cor_AlaPt(80)	L	121		Alarm Points	Communication error Frequency EAF
VentActual.Cor_AlaPt(81)	L	122		Alarm Points	Communication error Expansion unit 1
VentActual.Cor_AlaPt(82)	L	123		Alarm Points	Communication error Expansion unit 2
VentActual.Cor_AlaPt(83)	L	124		Alarm Points	Warning Frequency Converter SAF
VentActual.Cor_AlaPt(84)	L	125		Alarm Points	Warning Frequency Converter EAF
VentActual.Cor_AlaPt(85)	L	126		Alarm Points	Output in manual mode
VentActual.Cor_AlaPt(86)	L	127		Alarm Points	Time for service
VentActual.Cor_AlaPt(87)	L	128		Alarm Points	Manual Y4-Extra Sequence control
VentActual.Cor_AlaPt(88)	L	129		Alarm Points	Restart blocked after power-on
VentActual.Cor_DIReserved(2)	L	130		Alarm Points	Not used
VentActual.Cor_DIReserved(3)	L	131		Alarm Points	Not used
VentActual.Cor_DIReserved(4)	L	132		Alarm Points	Not used
VentActual.Cor_DIReserved(5)	L	133		Alarm Points	Not used

Input Status Register

Variable name	Variable type	Modbus address	Default value	Function	Description
VentActual.Cor_DIReserved(6)	L	134		Alarm Points	Not used
VentActual.Cor_DIReserved(7)	L	135		Alarm Points	Not used
VentActual.Cor_DIReserved(8)	L	136		Alarm Points	Not used
VentActual.Cor_DIReserved(9)	L	137		Alarm Points	Not used
VentActual.Cor_DIReserved(10)	L	138		Alarm Points	Not used
VentActual.Cor_DIReserved(11)	L	139		Alarm Points	Not used
VentActual.Cor_DIReserved(12)	L	140		Alarm Points	Not used
VentActual.Cor_DIReserved(13)	L	141		Alarm Points	Not used
VentActual.Cor_DIReserved(14)	L	142		Alarm Points	Not used
VentActual.Cor_DIReserved(15)	L	143		Alarm Points	Not used
VentActual.Cor_DIReserved(16)	L	144		Alarm Points	Not used
InputOutput.Exp1DigIn1	L	145		Digital inputs	Value of DI1 Expansion unit 1
InputOutput.Exp1DigIn2	L	146		Digital inputs	Value of DI2 Expansion unit 1
InputOutput.Exp1DigIn3	L	147		Digital inputs	Value of DI3 Expansion unit 1
InputOutput.Exp1DigIn4	L	148		Digital inputs	Value of DI4 Expansion unit 1
InputOutput.Exp1DigIn5	L	149		Digital inputs	Value of DI5 Expansion unit 1
InputOutput.Exp1DigIn6	L	150		Digital inputs	Value of DI6 Expansion unit 1
InputOutput.Exp1DigIn7	L	151		Digital inputs	Value of DI7 Expansion unit 1
InputOutput.Exp1DigIn8	L	152		Digital inputs	Value of DI8 Expansion unit 1
InputOutput.Exp1DigIn9	L	153		Universal inputs	Value of UDI1 Expansion unit 1
InputOutput.Exp1DigIn10	L	154		Universal inputs	Value of UDI2 Expansion unit 1
InputOutput.Exp1DigIn11	L	155		Universal inputs	Value of UD3 Expansion unit 1
InputOutput.Exp1DigIn12	L	156		Universal inputs	Value of UD4 Expansion unit 1
InputOutput.Exp1DigOut1	L	157		Digital outputs	Value of DO1 Expansion unit 1
InputOutput.Exp1DigOut2	L	158		Digital outputs	Value of DO2 Expansion unit 1
InputOutput.Exp1DigOut3	L	159		Digital outputs	Value of DO3 Expansion unit 1

Input Status Register

Variable name	Variable type	Modbus address	Default value	Function	Description
InputOutput.Exp1DigOut4	L	160		Digital outputs	Value of DO4 Expansion unit 1
InputOutput.Exp1DigOut5	L	161		Digital outputs	Value of DO5 Expansion unit 1
InputOutput.Exp1DigOut6	L	162		Digital outputs	Value of DO6 Expansion unit 1
InputOutput.Exp1DigOut7	L	163		Digital outputs	Value of DO7 Expansion unit 1
InputOutput.Exp2DigIn1	L	164		Digital inputs	Value of DI1 Expansion unit 2
InputOutput.Exp2DigIn2	L	165		Digital inputs	Value of DI2 Expansion unit 2
InputOutput.Exp2DigIn3	L	166		Digital inputs	Value of DI3 Expansion unit 2
InputOutput.Exp2DigIn4	L	167		Digital inputs	Value of DI4 Expansion unit 2
InputOutput.Exp2DigIn5	L	168		Digital inputs	Value of DI5 Expansion unit 2
InputOutput.Exp2DigIn6	L	169		Digital inputs	Value of DI6 Expansion unit 2
InputOutput.Exp2DigIn7	L	170		Digital inputs	Value of DI7 Expansion unit 2
InputOutput.Exp2DigIn8	L	171		Digital inputs	Value of DI8 Expansion unit 2
InputOutput.Exp2DigIn9	L	172		Universal inputs	Value of UDI1 Expansion unit 2
InputOutput.Exp2DigIn10	L	173		Universal inputs	Value of UDI2 Expansion unit 2
InputOutput.Exp2DigIn11	L	174		Universal inputs	Value of UDI3 Expansion unit 2
InputOutput.Exp2DigIn12	L	175		Universal inputs	Value of UDI4 Expansion unit 2
InputOutput.Exp2DigOut1	L	176		Digital outputs	Value of DO1 Expansion unit 2
InputOutput.Exp2DigOut2	L	177		Digital outputs	Value of DO2 Expansion unit 2
InputOutput.Exp2DigOut3	L	178		Digital outputs	Value of DO3 Expansion unit 2
InputOutput.Exp2DigOut4	L	179		Digital outputs	Value of DO4 Expansion unit 2
InputOutput.Exp2DigOut5	L	180		Digital outputs	Value of DO5 Expansion unit 2
InputOutput.Exp2DigOut6	L	181		Digital outputs	Value of DO6 Expansion unit 2

Input Status Register

Variable name	Variable type	Modbus address	Default value	Function	Description
InputOutput.Exp2DigOut7	L	182		Digital outputs	Value of DO7 Expansion unit 2
VentActual.Cor_RecycleRunActive	L	183		Actual/Setpoint	Start signal Heat Pump
VentActual.Cor_SumAlarm	L	184		Alarm Status	Sumalarm, is set if any A or B alarm
VentActual.Cor_SumAlarmA	L	185		Alarm Status	A-alarm, is set if any A-alarm in controller
VentActual.Cor_SumAlarmB	L	186		Alarm Status	B-alarm, is set if any B-alarm in controller
VentActual.Cor_DIReserved(20)	L	187		Not used	Not used
VentActual.Cor_DIReserved(20)	L	188		Not used	Not used
VentActual.Cor_DIReserved(20)	L	189		Not used	Not used
VentActual.Cor_DIReserved(20)	L	190		Not used	Not used
VentActual.Cor_DIReserved(20)	L	191		Not used	Not used
VentActual.Cor_DIReserved(20)	L	192		Not used	Not used

